Geothermal power in the reality of the electricity market

Session III: Plant operation, energy supply and grid integration

GEOELEC training course Pisa
9. October 2013

Topic of the presentation: energy supply, electricity grid & plant operation
department: Research & Innovation
author: Sören Reith
version: 131008

EnBW
Energie
braucht Impulse

Table of content

1. Energy supply
   a. Regulation
   b. Energy trade
   c. Support Systems for RES in Europe
2. Electricity grid
   a. General structure of the electricity grid
   b. Power flows in Europe
   c. Integration of renewable energies
   d. Control of the European electricity grid
3. Plant operation
   a. Demand for geothermal power
   b. Lessons learned

Brief portrait
EnBW Energie Baden-Württemberg AG

- One of the largest energy companies in Germany and Europe
- Business segments:
  electricity generation and trading, electricity grid and sales, gas, energy and environmental services
- Annual revenue 2012: in excess of € 19 billion
- Customers: some 5,5 million
- employees: some 20,000
- Installed capacity: 13 042 MW thereof 2 527 MW renewable
- 2 geothermal power plants

Geothermal power plant in Soultz-sous-Forêts, France
Upper Rhine Valley

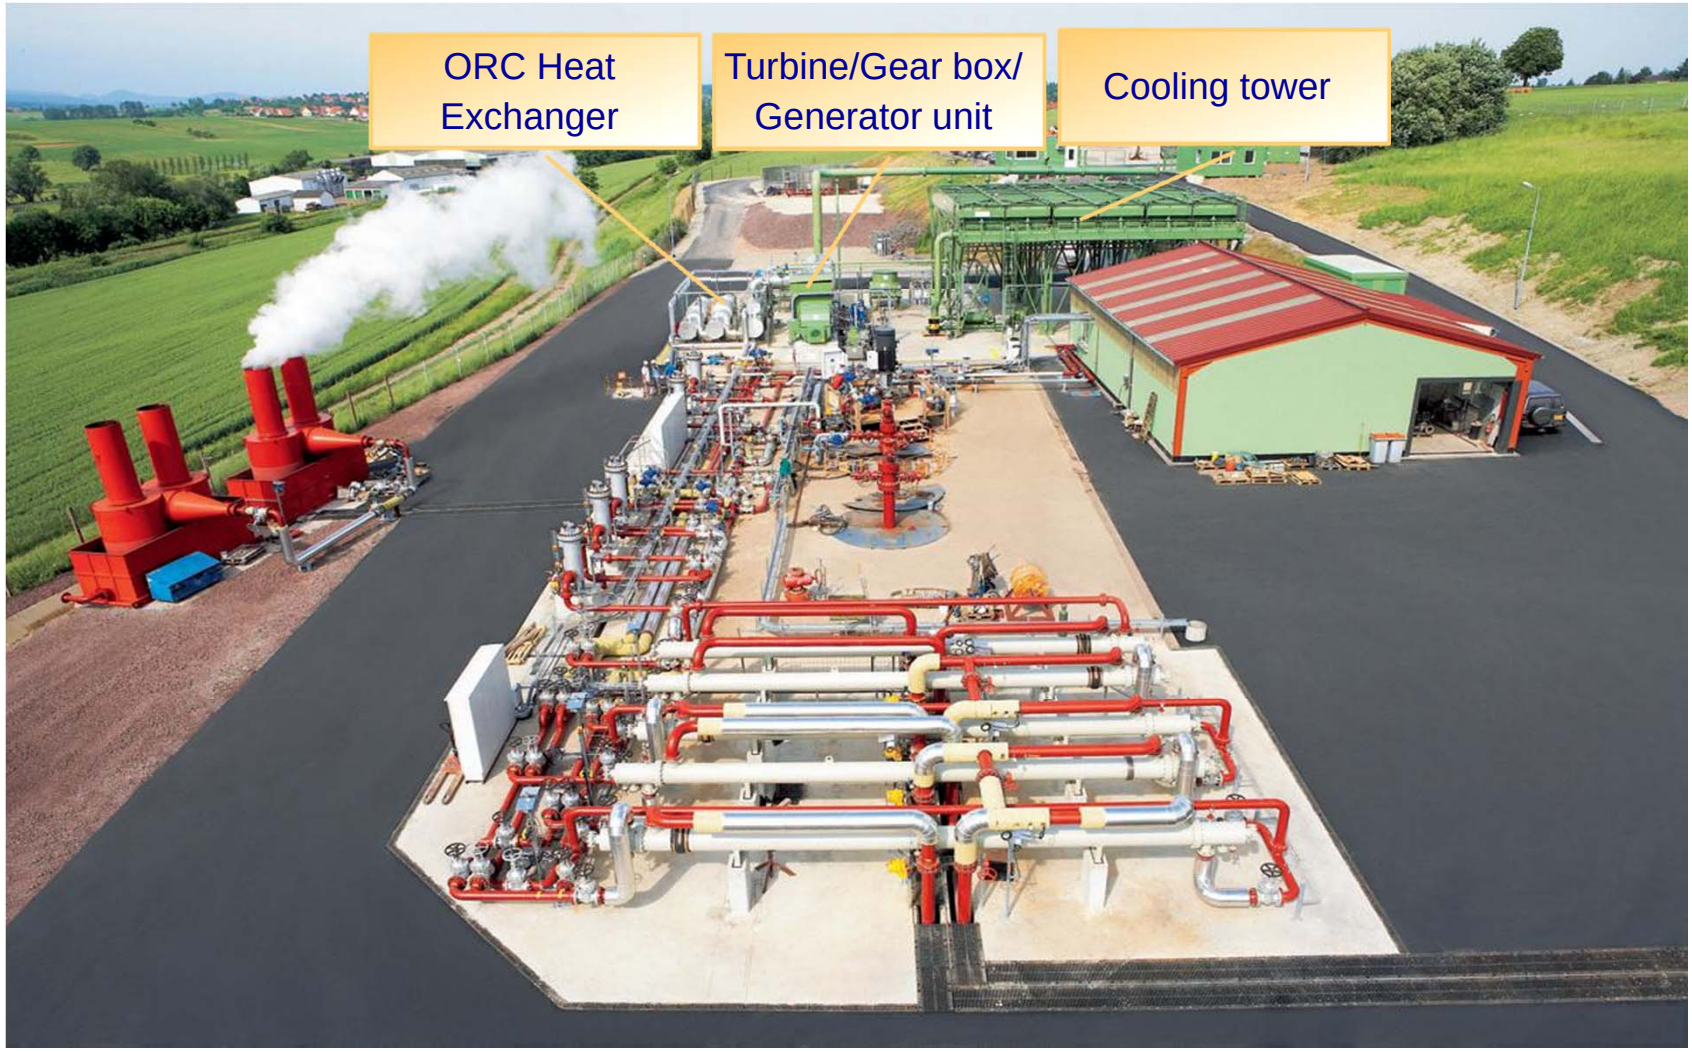

Source G.E.I.E, 2010

Geothermal power plant – Soultz-sous-Forêts

French-German consortium (federal agencies, research agencies; industry)

Thermal capacity

25-35 l/s
Flow rate

175 °C
Flow temperature

70 °C
Return flow temperature

~ 14 MW
Thermal capacity

Power plant

ORC power plant

~ 19 bar
Pressure

Isobutan
Working fluid

Air cooling tower

~ 2,1 MW
Gross electrical output

boreholes

EGS-power plant

4
Number of boreholes

3600 m / 5100 m / 5100 m / 5260 m
Depth of GPK1/GPK2/GPK3/GPK4

Electric submersible pump/ lineshaft pump

Geothermal power plant Bruchsal - Kalina pilot plant

Geothermal power plant – Bruchsal

consortium between ewb & EnBW

Thermal water

24 l/s
Flow rate

120 °C
Flow temperature

60 °C
Return flow temperature

~ 5.5 MW
Thermal capacity

Power plant

Kalina power plant

~ 22 bar
pressure

Water-ammonia
Working fluid

Wet cooling tower

~ 0.55 MW
Gross electrical output

boreholes

Hydrothermal

2
Number of boreholes

- 1874 m/ - 2542 m
Depth of GBI/GBII

Electric Submersible pump

Table of contents

1. **Energy supply**
   a. **Regulation**
   b. **Energy trade**
   c. **Support Systems for RES in Europe**
2. Electricity grid
   a. General structure of the electricity grid
   b. Power flows in Europe
   c. Integration of renewable energies
   d. Control of the European electricity grid
3. Plant operation
   a. Demand for geothermal power
   b. Lessons learned

Regulation in the European electricity business

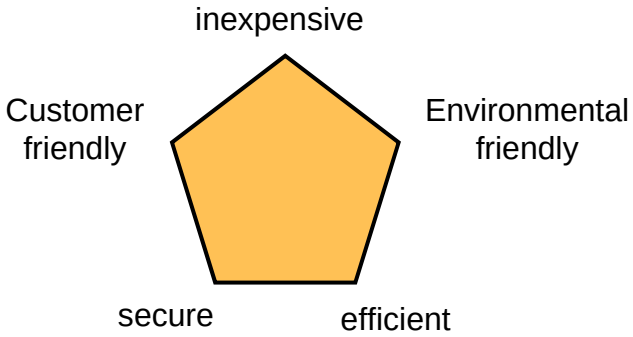

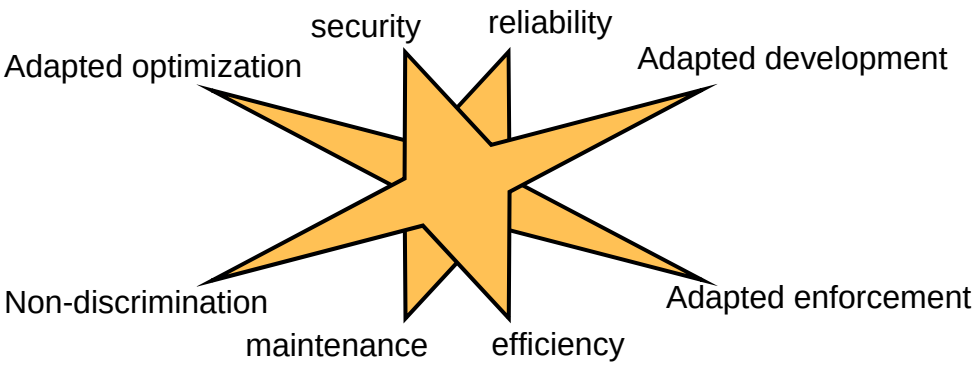

- 96/92/EC – Liberalization of electricity and gas markets
  - Free Choice of electricity supplier
  - Unbundling of production; transport; distribution; sales/trade
  - Discrimination free grid access
  - Network fees are regulated

Electricity trade in the liberalised market

Exchange trading
Standardized products, lower transaction costs, anonym, lower default risk

Bilateral-/OTC-trade
Individual negotiated contracts, not regulated, only few market participants, higher transaction costs, higher default risk

Spotmarket
Conclusion of the contract and its fulfilment are close together
Physical → electricity delivery

- **Electricity exchange**
  standardized products
  base-products
  peak-products
  hours-products
- **OTC-trade**

Derivates market
Between conclusion and fulfilment is at least one weak
Hedging transactions

- Buyer has an exercise right; Seller is obligated to fulfilment
  - **Options**
    Caps
    Floors
    - **Exchange trade** (Options)
    - **OTC-trade** (all trade products)
- Buyer and Seller are obligated to fulfilment
  - **Forwards**
    Futures
    Swaps
    - **Exchange trade** (Futures)
    - **OTC-trade** (all trade products)

Source: Konstantin, 2007, S. 42

Electricity trade in the liberalised market

Development of the electricity price - theoretical

- Electricity prices develop through the equilibrium of
  - Offered power plant capacity (Merit-Order)
  - Load demand.
- Amount offered, price and demand are influenced by different circumstances.
- Typically there are hourly price equilibriums identified

→ This means 8760 different markets with different influencing factors

- The last power plant sets the price

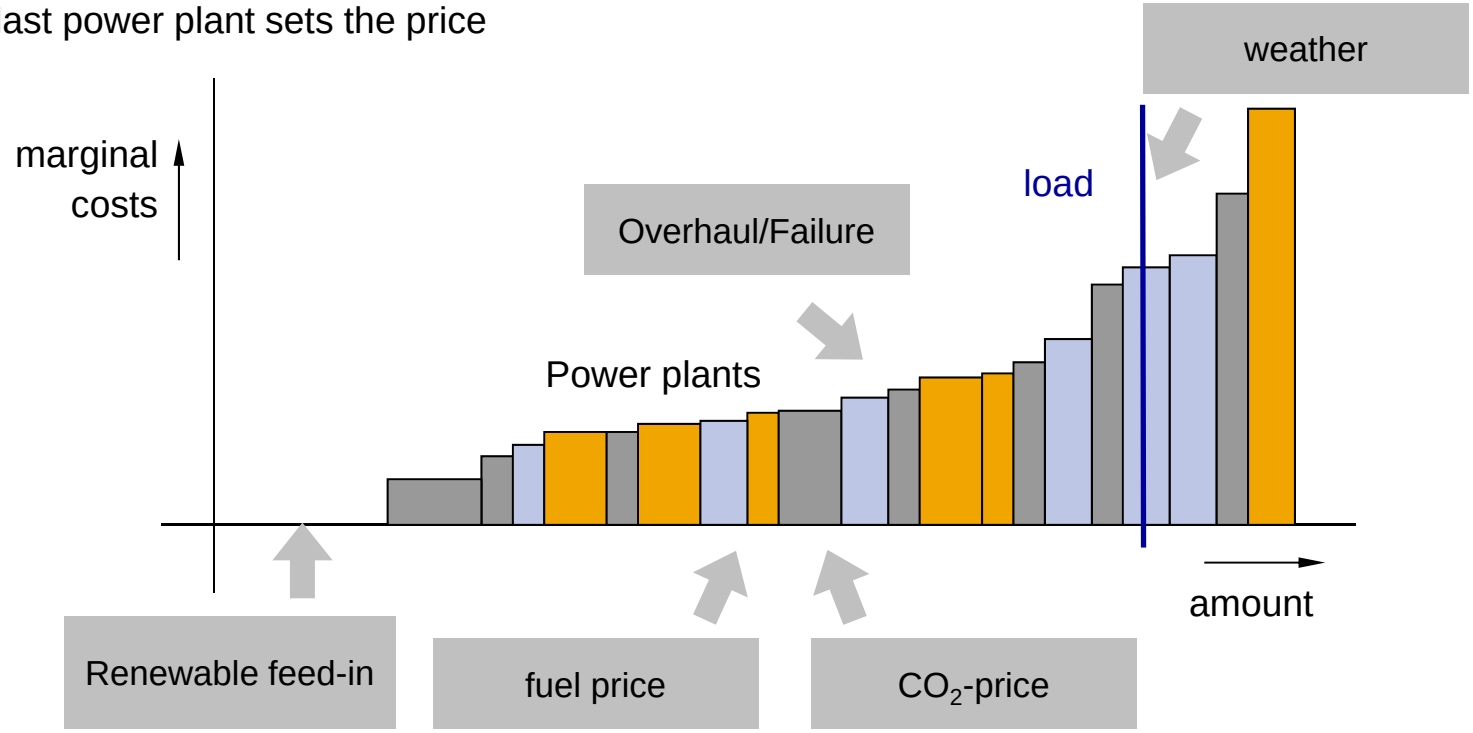

Spotmarket Germany 07.10.2013

Preis

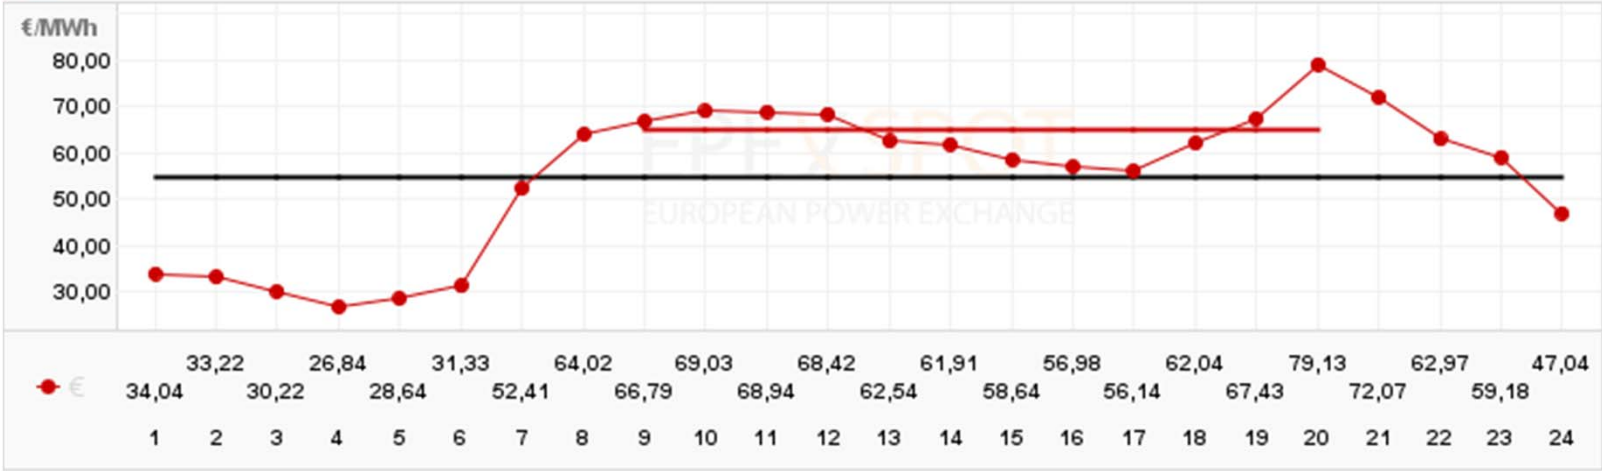

Volumen

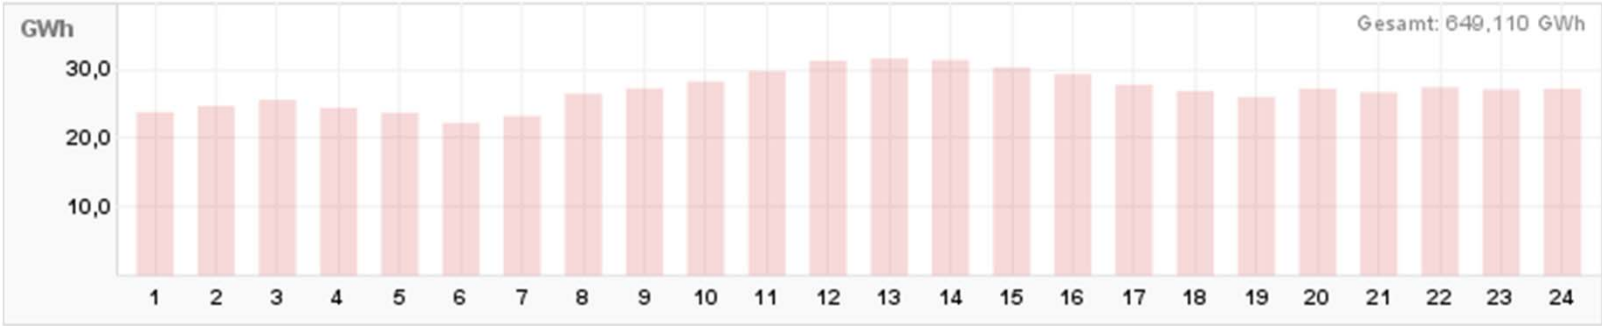

Support Systems for renewable energy in Europe
Directive 2009/28/EC

- Goals
  - Reduction of CO_2 – emissions
  - Reduction of the dependence on fossil energies
  - Fulfilment of the individual goals from directive 2009/28/EC
- Directive 2009/28/EC guaranties a priority feed-in for Renewables

Feed-in tariffs	• Legal determined feed-in tariff • Customers are charged for the extra costs
Quota systems	• Legally determined quota for RES in the elec. production • Projects are financed through energy price and certificate price
Tender models	• Tendering for a fixed amount for renewable capacity • Cheapest project is done
Tax reduction	• Tax reduction for renewable energy • Widely used

Support Systems for renewable energy in Europe

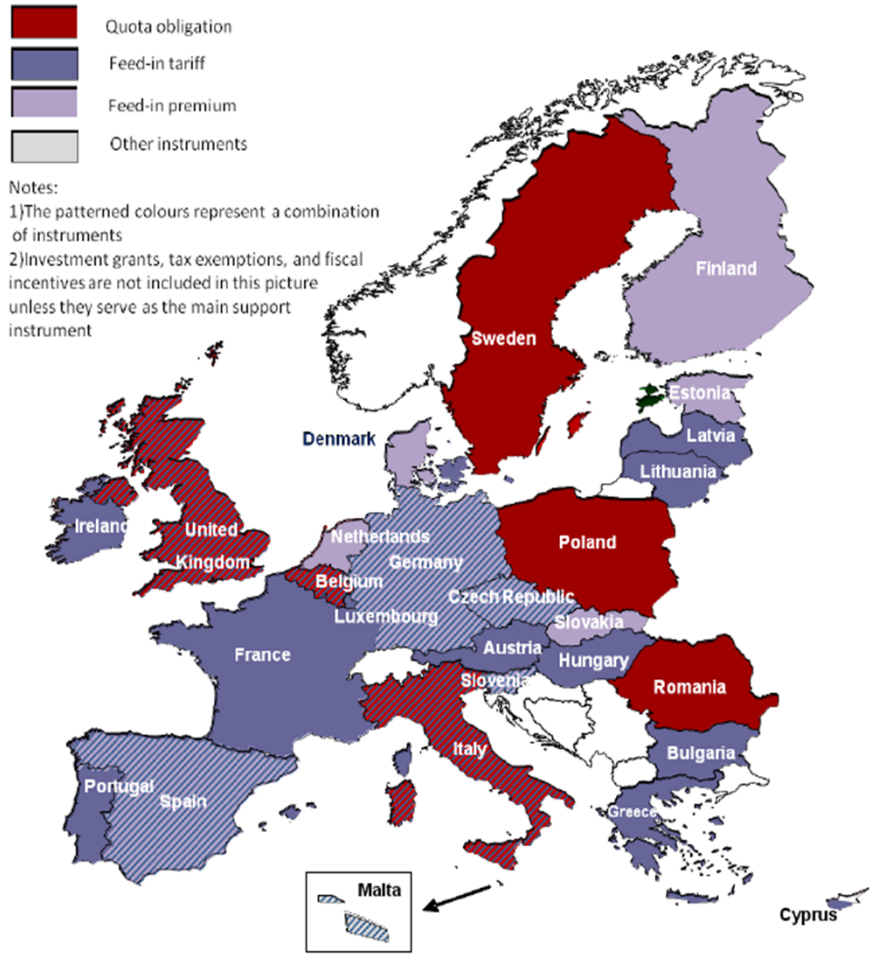

Source: Ragwitz et.a l.; 2012; Recent developments of feed-in systems in the EU

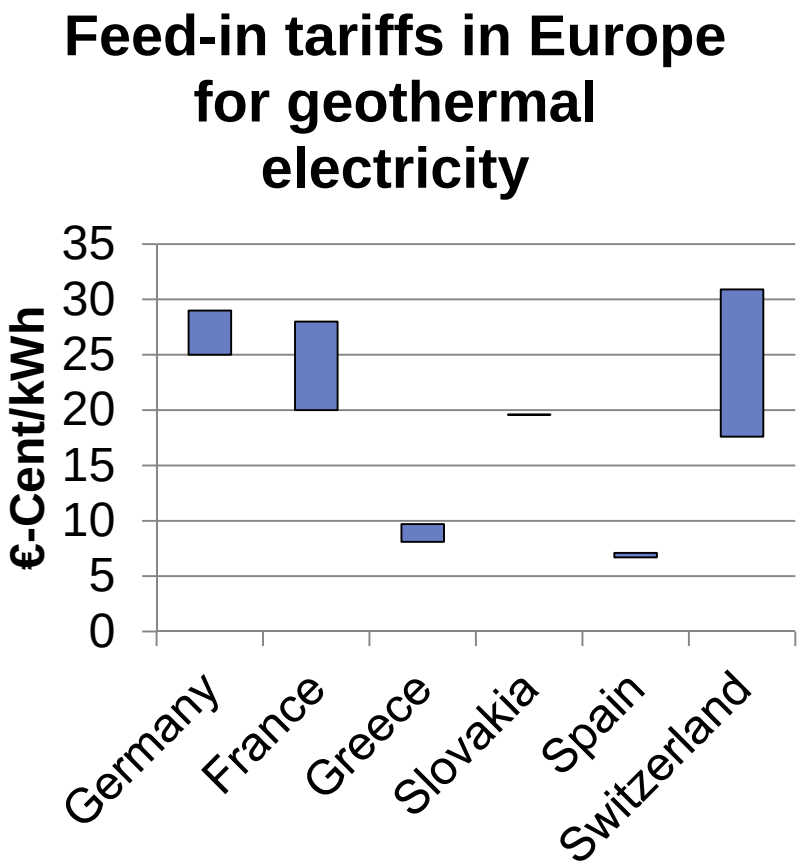

Source: Gipe; 2011; Geothermal Feed-in Tarifs Worldwide

Table of contents

1. Energy supply
   a. Regulation
   b. Energy trade
   c. Support Systems for RES in Europe
2. **Electricity grid**
   a. **General structure of the electricity grid**
   b. **Power flows in Europe**
   c. **Integration of renewable energies**
3. Plant operation
   a. Demand for geothermal power
   b. Lessons learned

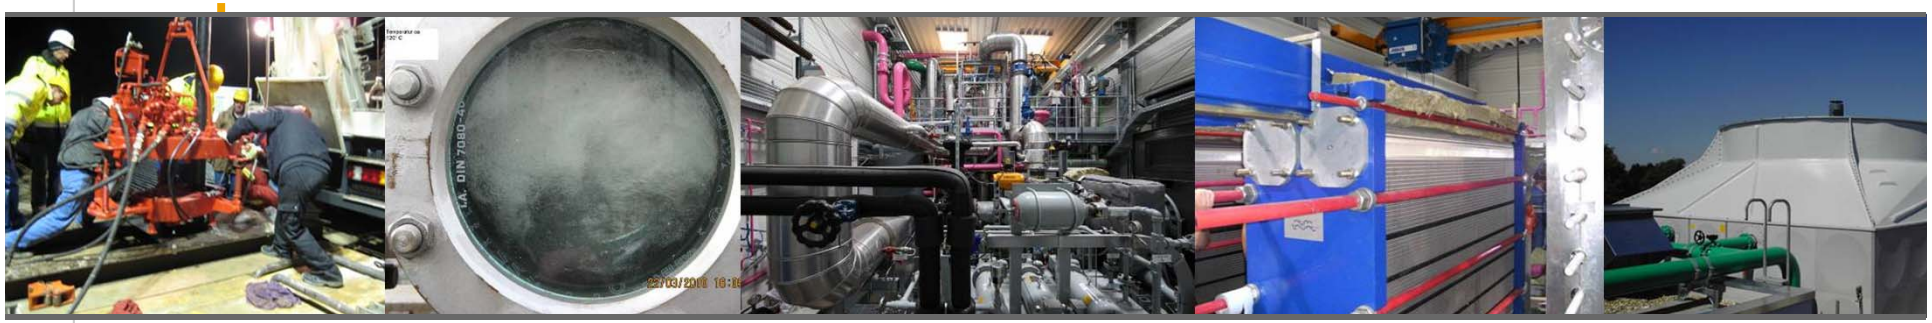

Load distribution in the network

›Quelle: M.Beer, CO2-Vermeidung in DE, Teil II „Umwandlung & Ind., S.17, FfE München, 2009,

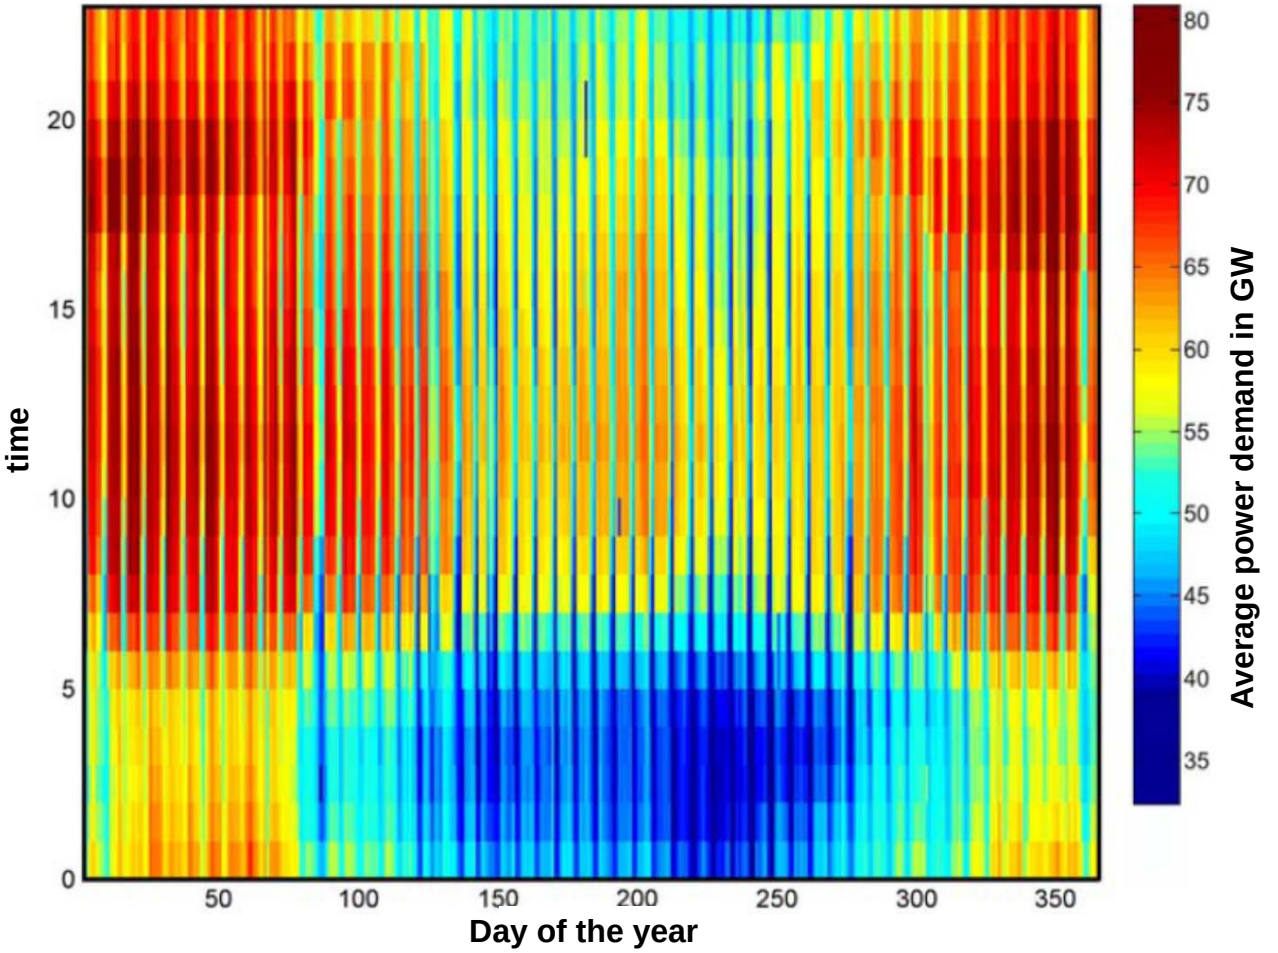

The electricity network

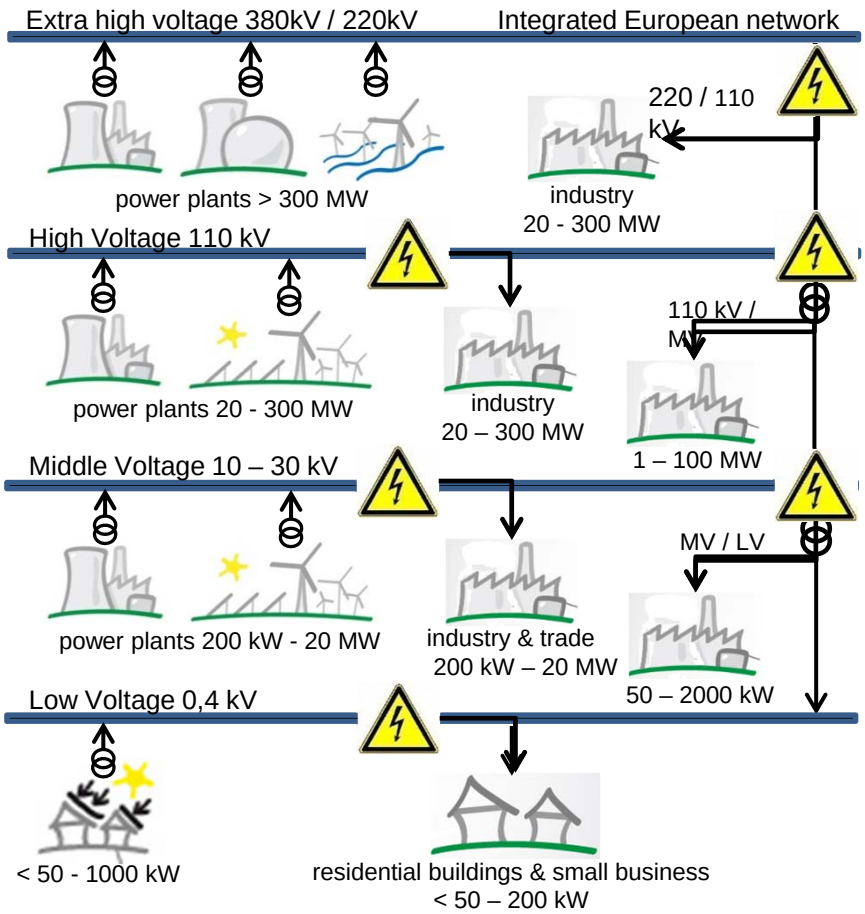

Fundamentals of electricity distribution:

$$P = U * I * \sqrt{3} * \cos\varphi$$

$$P_V = n * R' * d * I^2$$

- Different losses occur through electricity transport
  - Losses of the alternating current (AC)
  - Losses of the overhead lines
  - Losses of the wire
- Losses of the wire
  - Ohmic resistance
  - Limited heat resistance

Load and demand in Europe

Country analyses under normal & severe conditions

no imports required
to maintain demand & reserve

imports required
to maintain demand & reserve on at least one week

imports required
to maintain demand & reserve every week

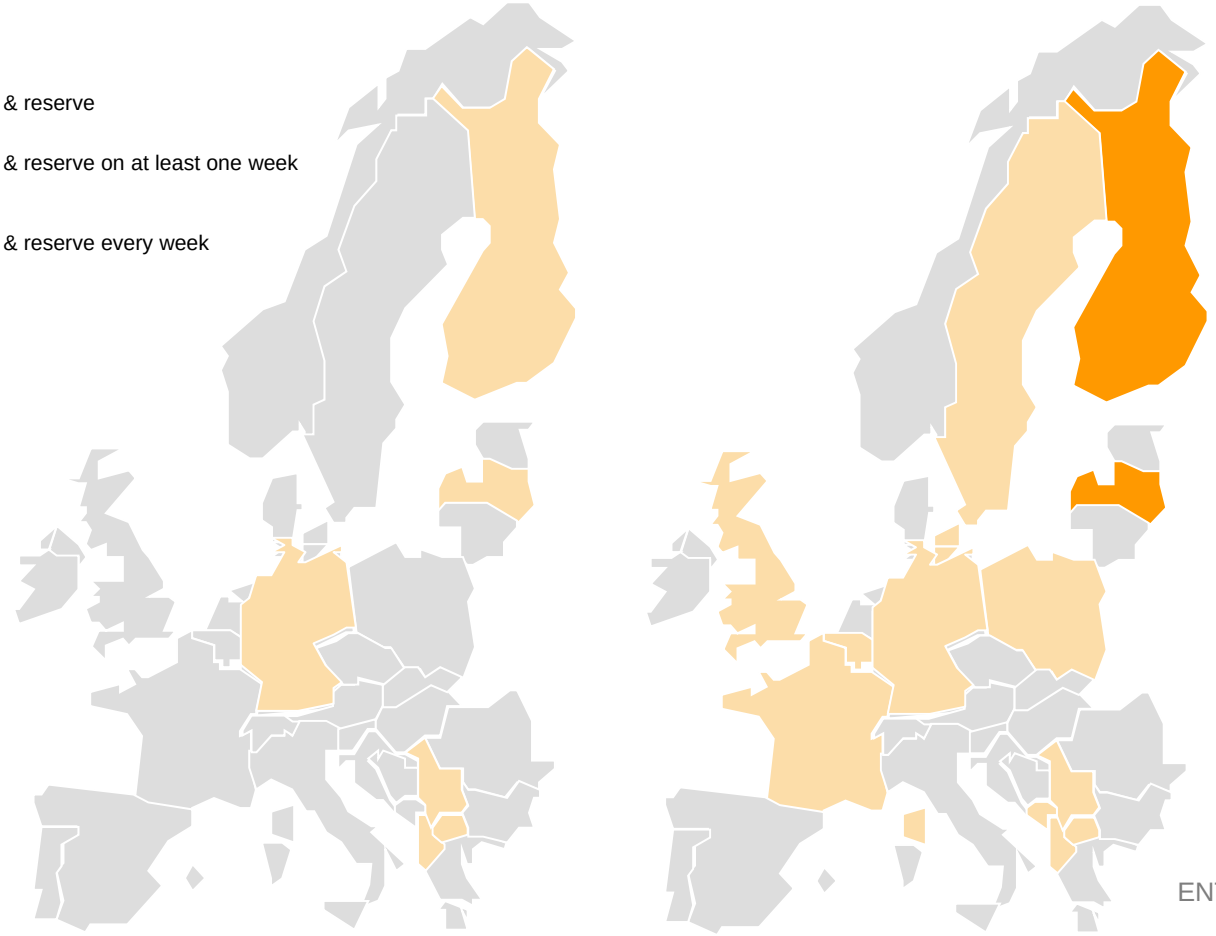

ENTSO-E 2011

Physical power flows in Central - Europe 17.10.2012;

Export vs. Import

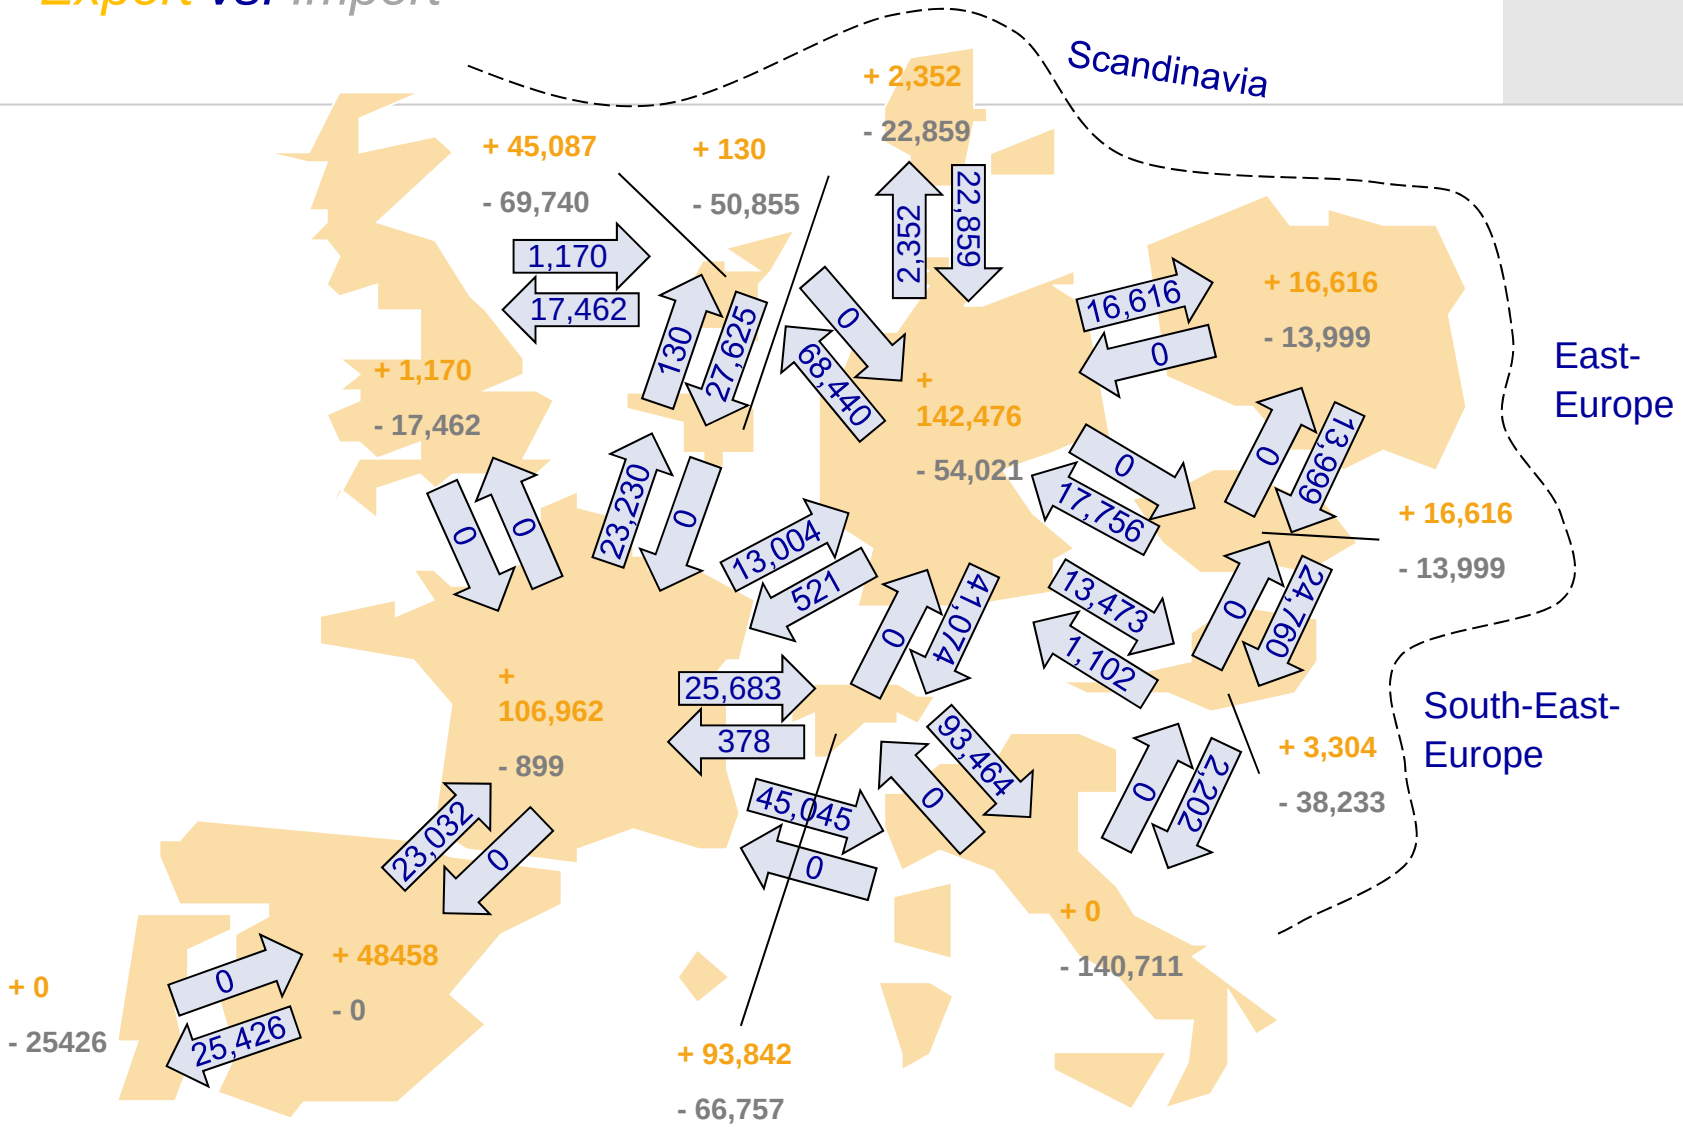

Source: entso-e

Physical power flows between Germany and Switzerland 17.10.2012

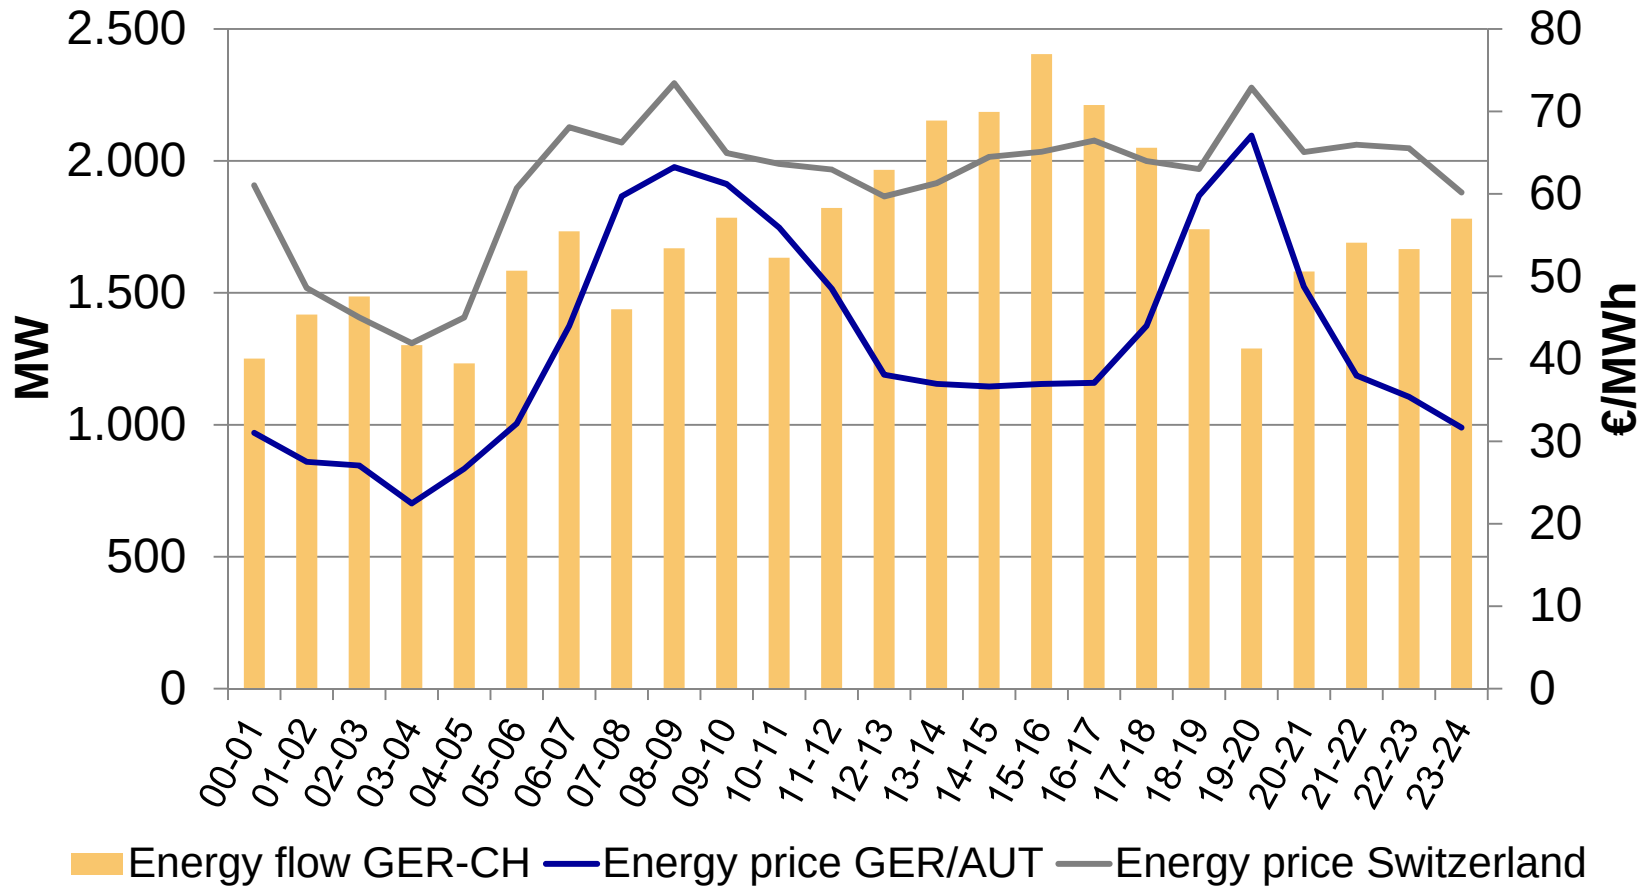

Source: entso-e; EEX

Transport capacity – a more and more scare good

Challenges for the network operation in Europe

Example: TenneT-control zone

- Currently there is a high burden through wind energy and trade flows from Scandinavia
- 6.200 MW transport capacity/ 3.500 MW min. demand

- Additional wind capacity
- Integration of new power plants
- Expansion of transport capacity with Scandinavia is demanded

Example:

- Central Europe at the 22.12.04, 17:30 h, phys. Load flows
- Wind feed-in: 11,461 MW
- Export balance: ca. 6200 MW

Result:

- With a growing wind feed-in the electricity is pushed in the neighbouring countries
- Growing stress on the cross-border transfer capacity
- Overloading of the neighbouring networks

Import-/Export balance depending on the producing wind capacity 2008

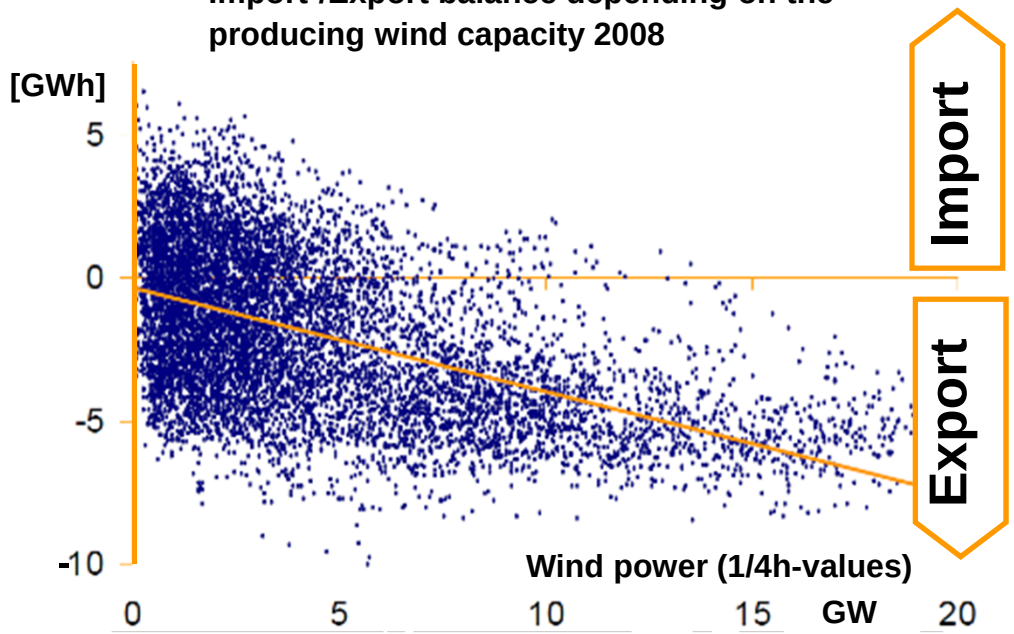

Wind energy feed-in in the TenneT-network, Aug. 2010

prognosis and real feed-in

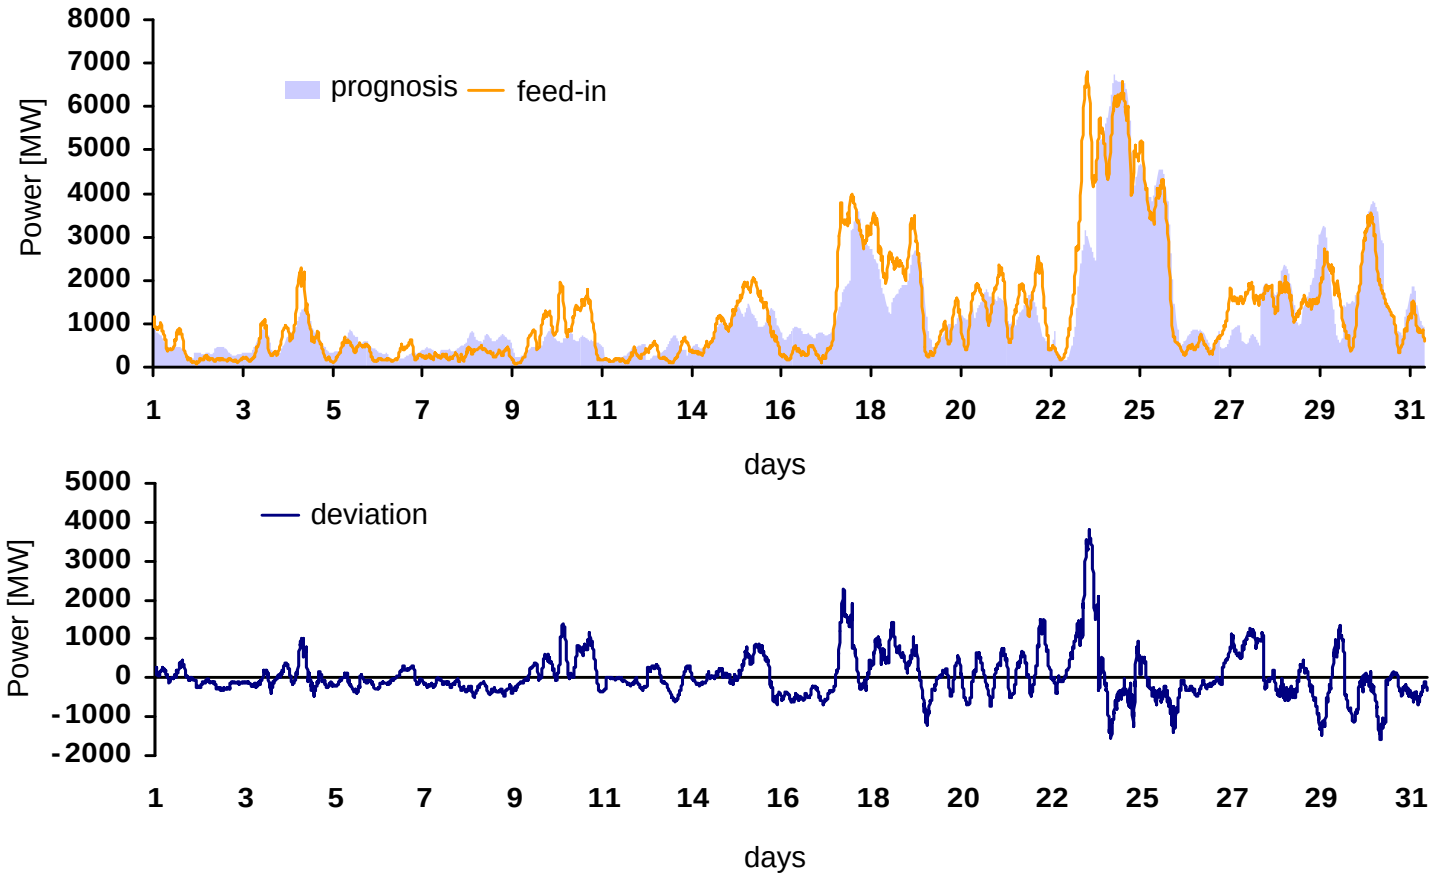

Market reaction strong wind situation 25./26.12.2009:

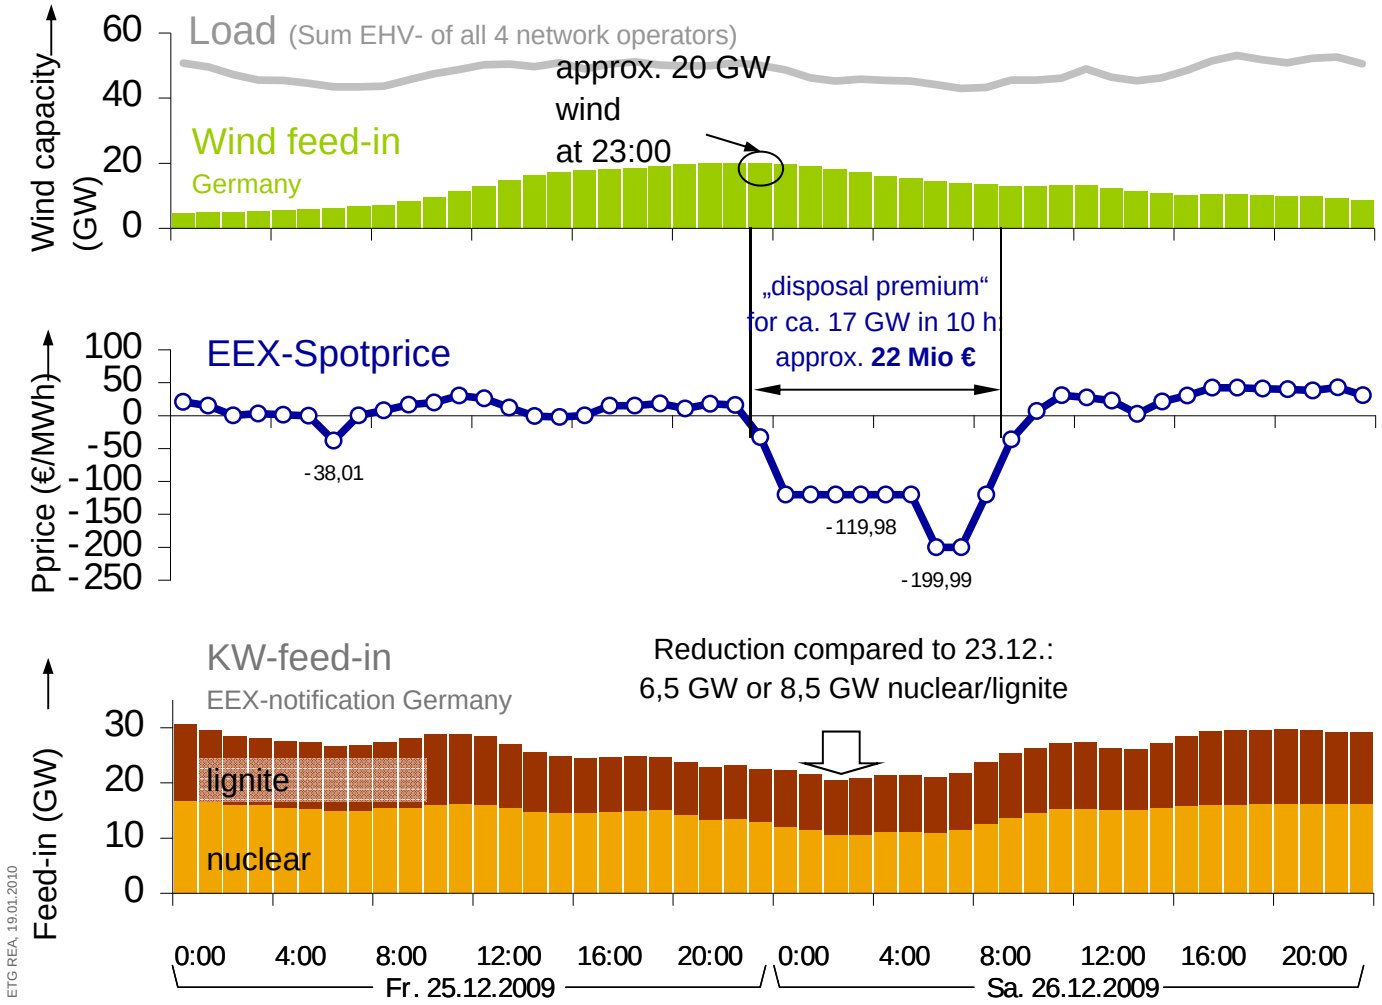

September 2013:

31.8 GW installed wind capacity in Germany

ETG REA, 19.01.2010

The Challenge

Difference between electricity demand and operating wind capacity

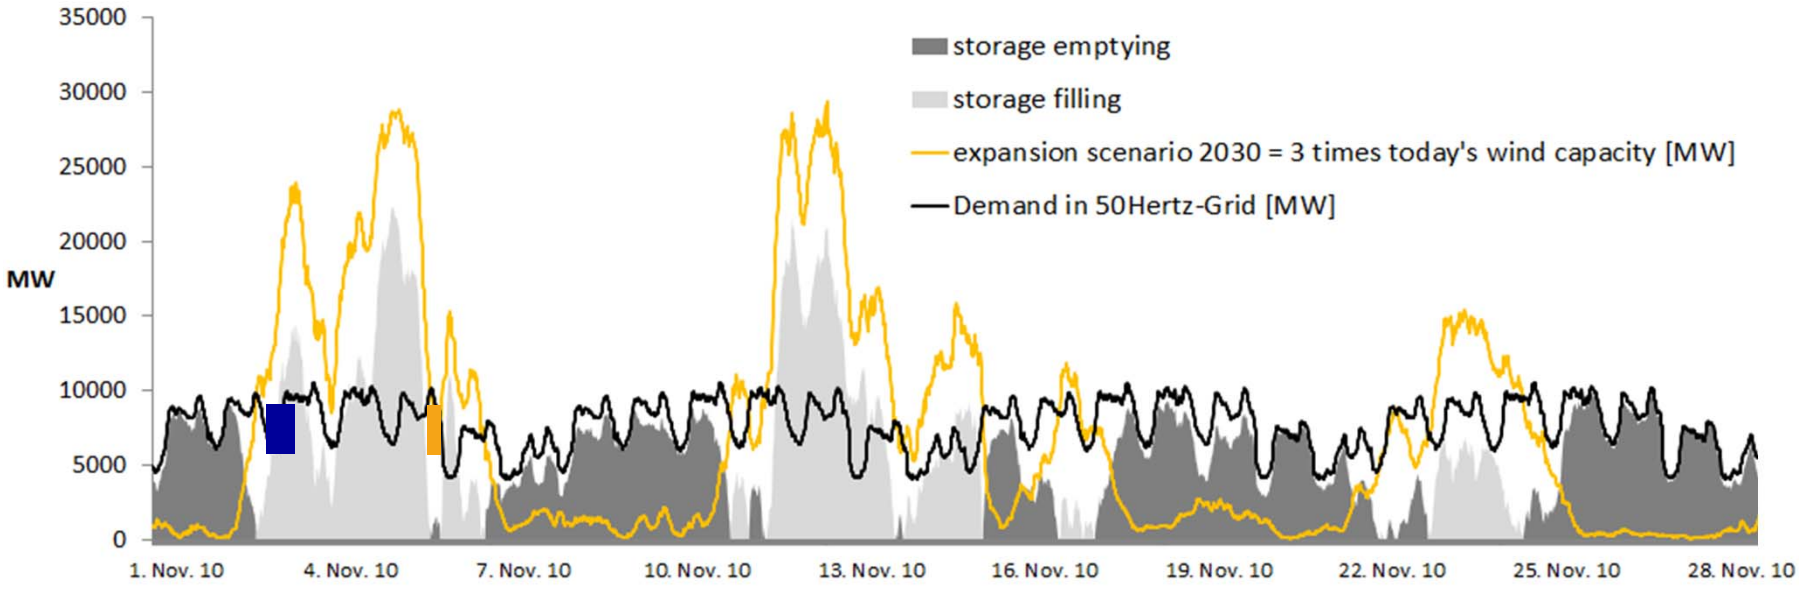

German pump storage capacity(~40 GWh)

Pump storage Goldisthal (~8,6 GWh)

Table of contents

1. Energy supply
   a. Regulation
   b. Energy trade
   c. Support Systems for RES in Europe
2. Electricity grid
   a. General structure of the electricity grid
   b. Power flows in Europe
   c. Integration of renewable energies
   d. Control of the European electricity grid
3. **Plant operation**
   a. **Demand for geothermal power**
   b. **Lessons learned**

European directives and goals concerning renewable/geothermal energy sources

- European directive 2009/28/EC
  - Article 2a: “energy from renewable sources’ means energy from renewable non-fossil sources, namely wind, solar, aerothermal, geothermal, … “
  - Article 2c: “geothermal energy’ means energy stored in the form of heat beneath the surface of solid earth;”

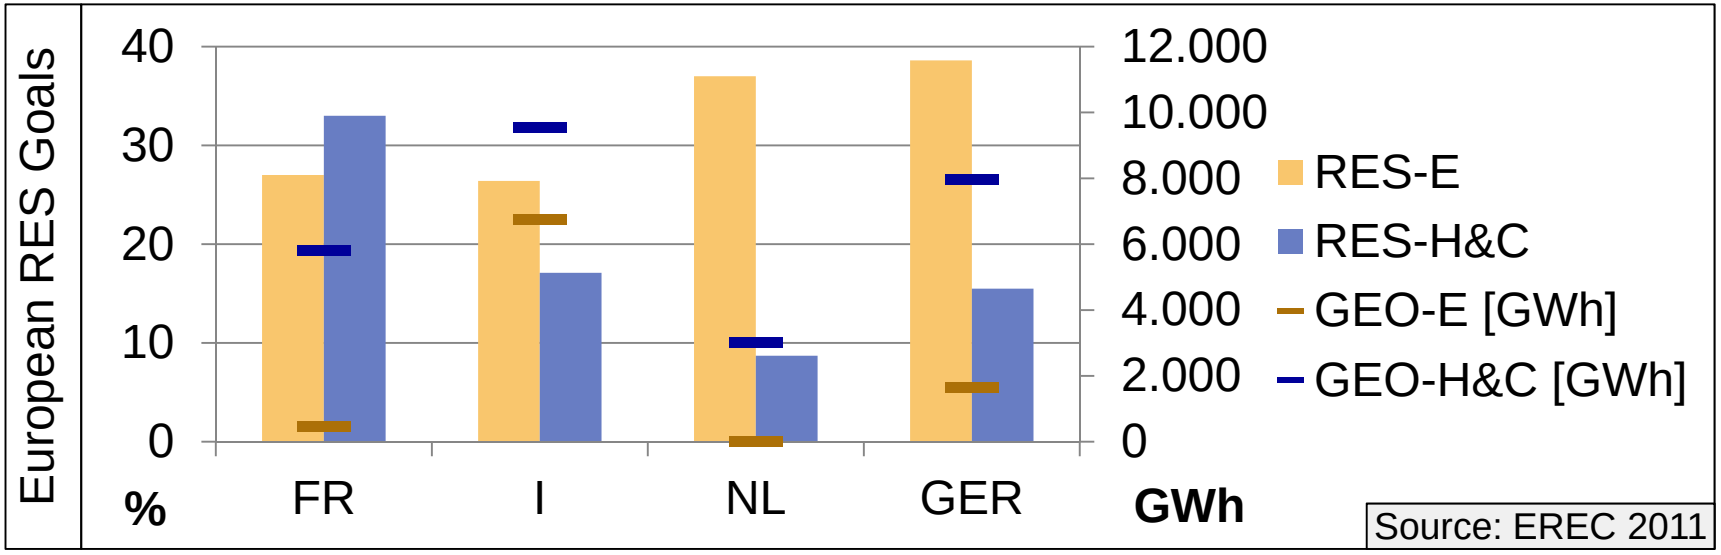

Geothermal power plants in Germany

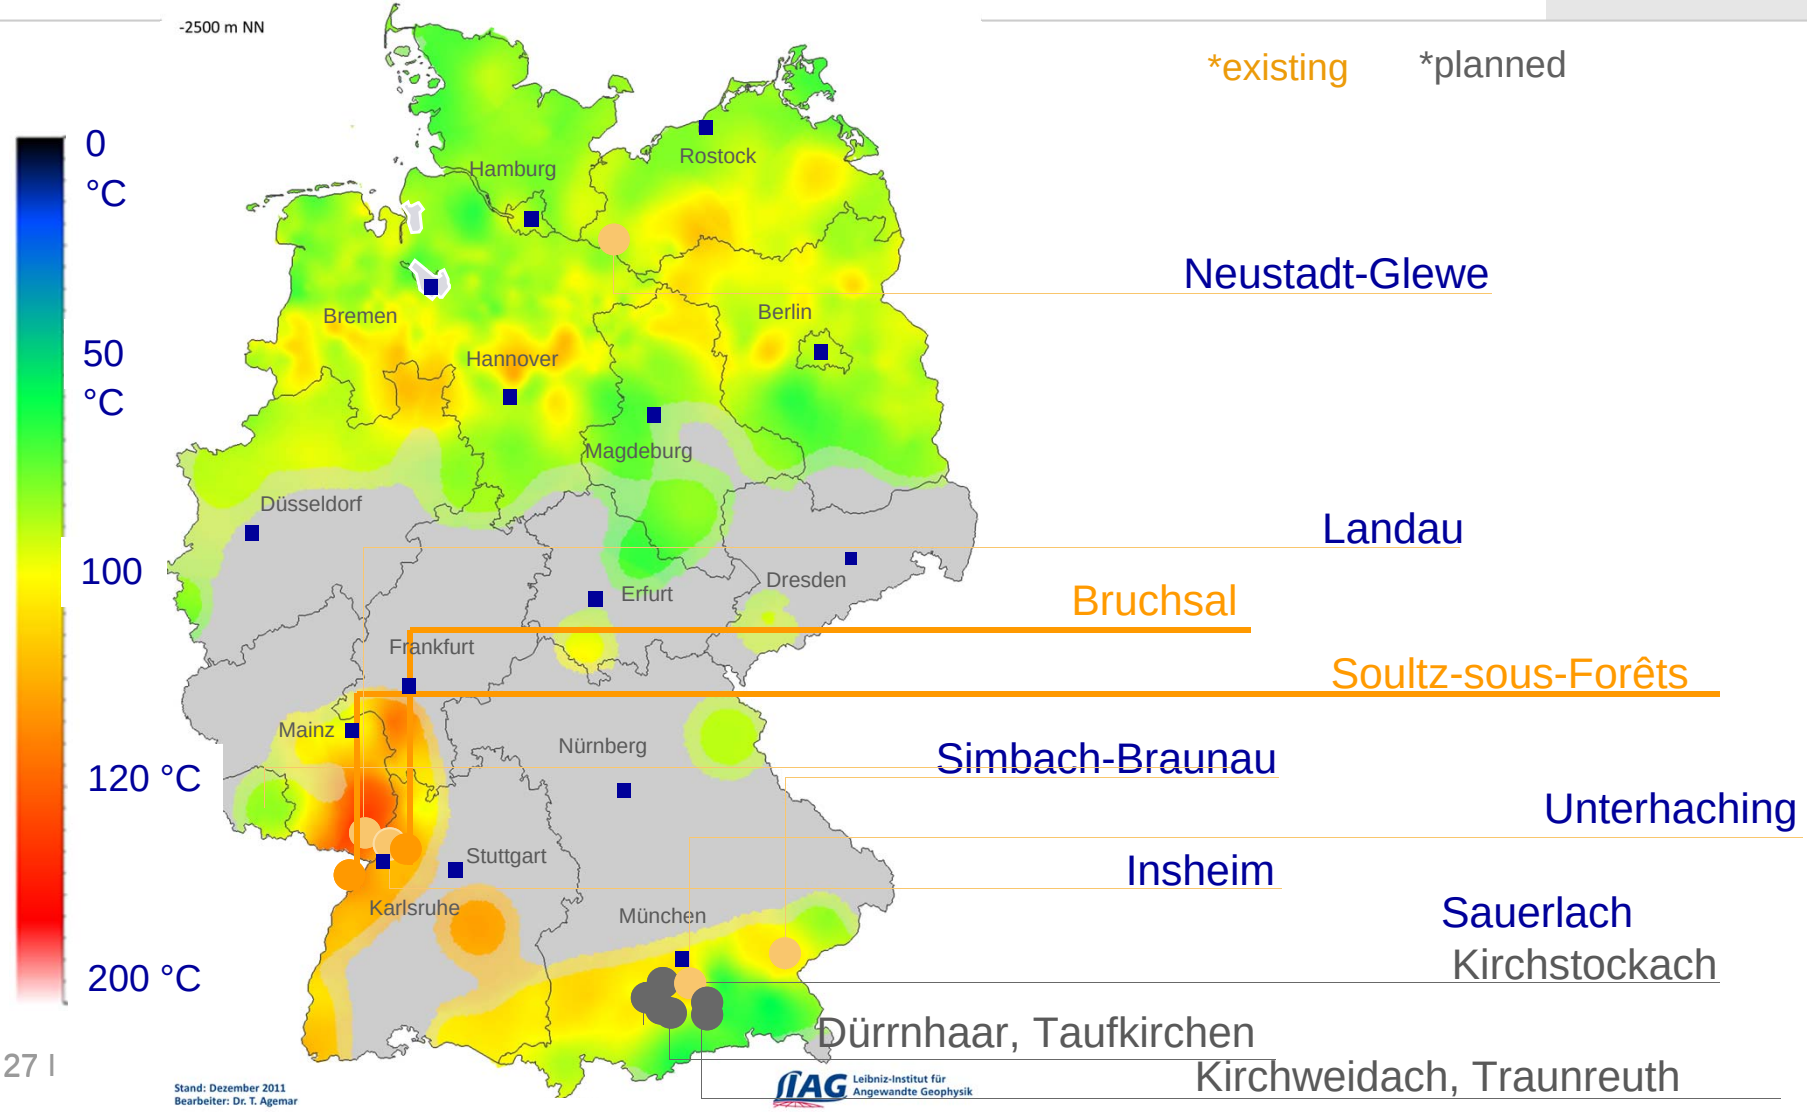

Capacity factors for electricity production

Availability of power plants

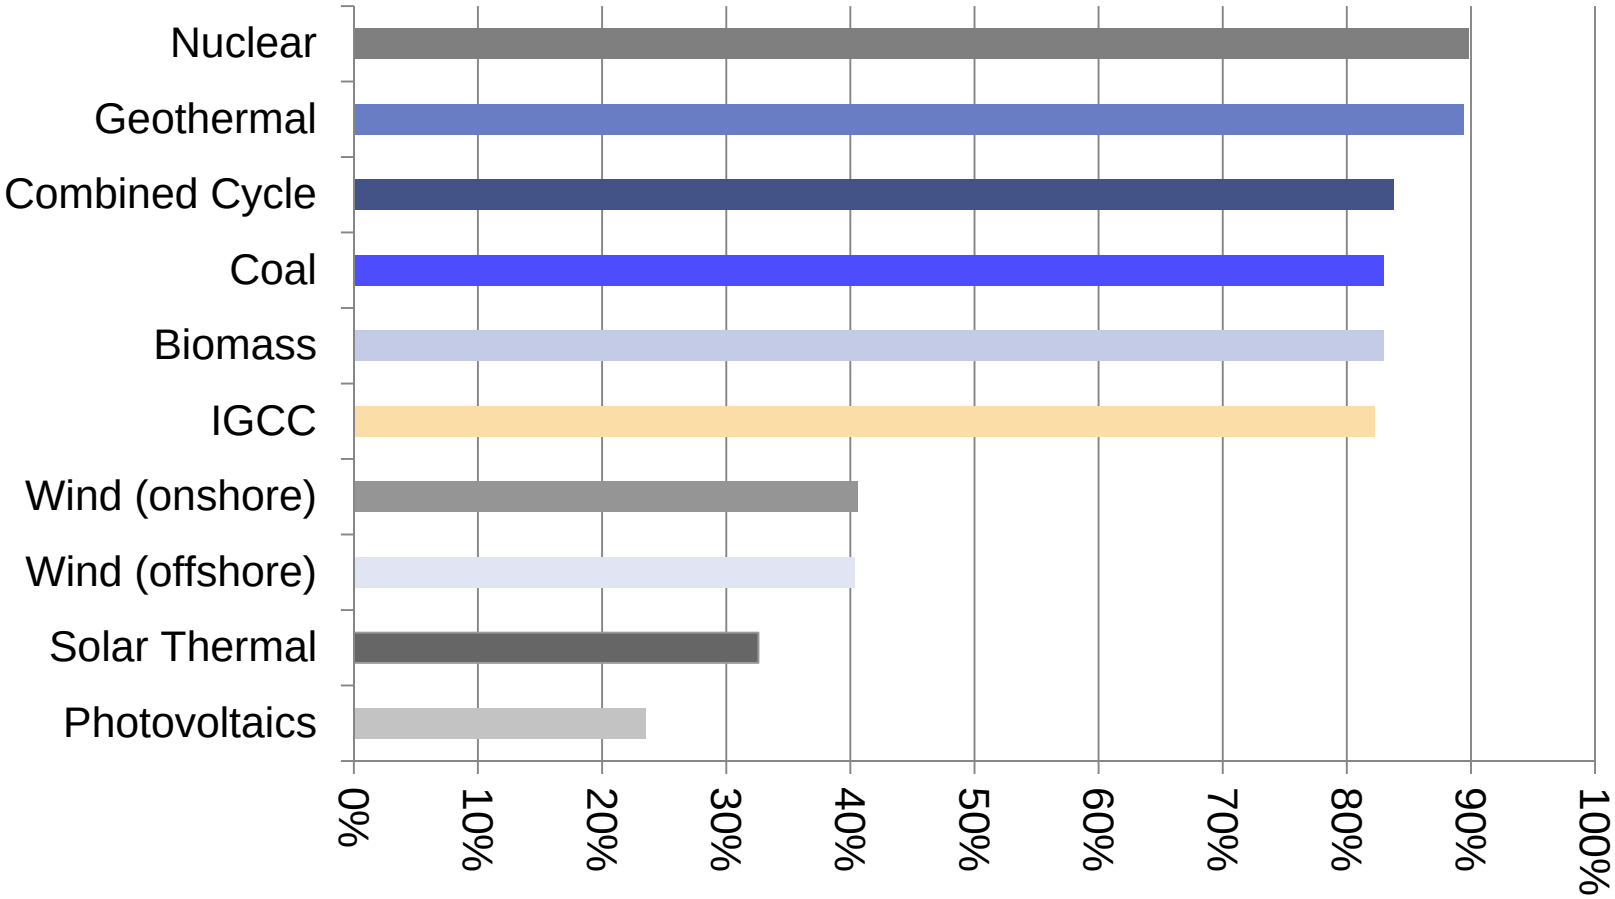

Source: (Tidball, Bluestein, Rodriguez, & Knoke, 2010)

Future demand for controllable renewable power

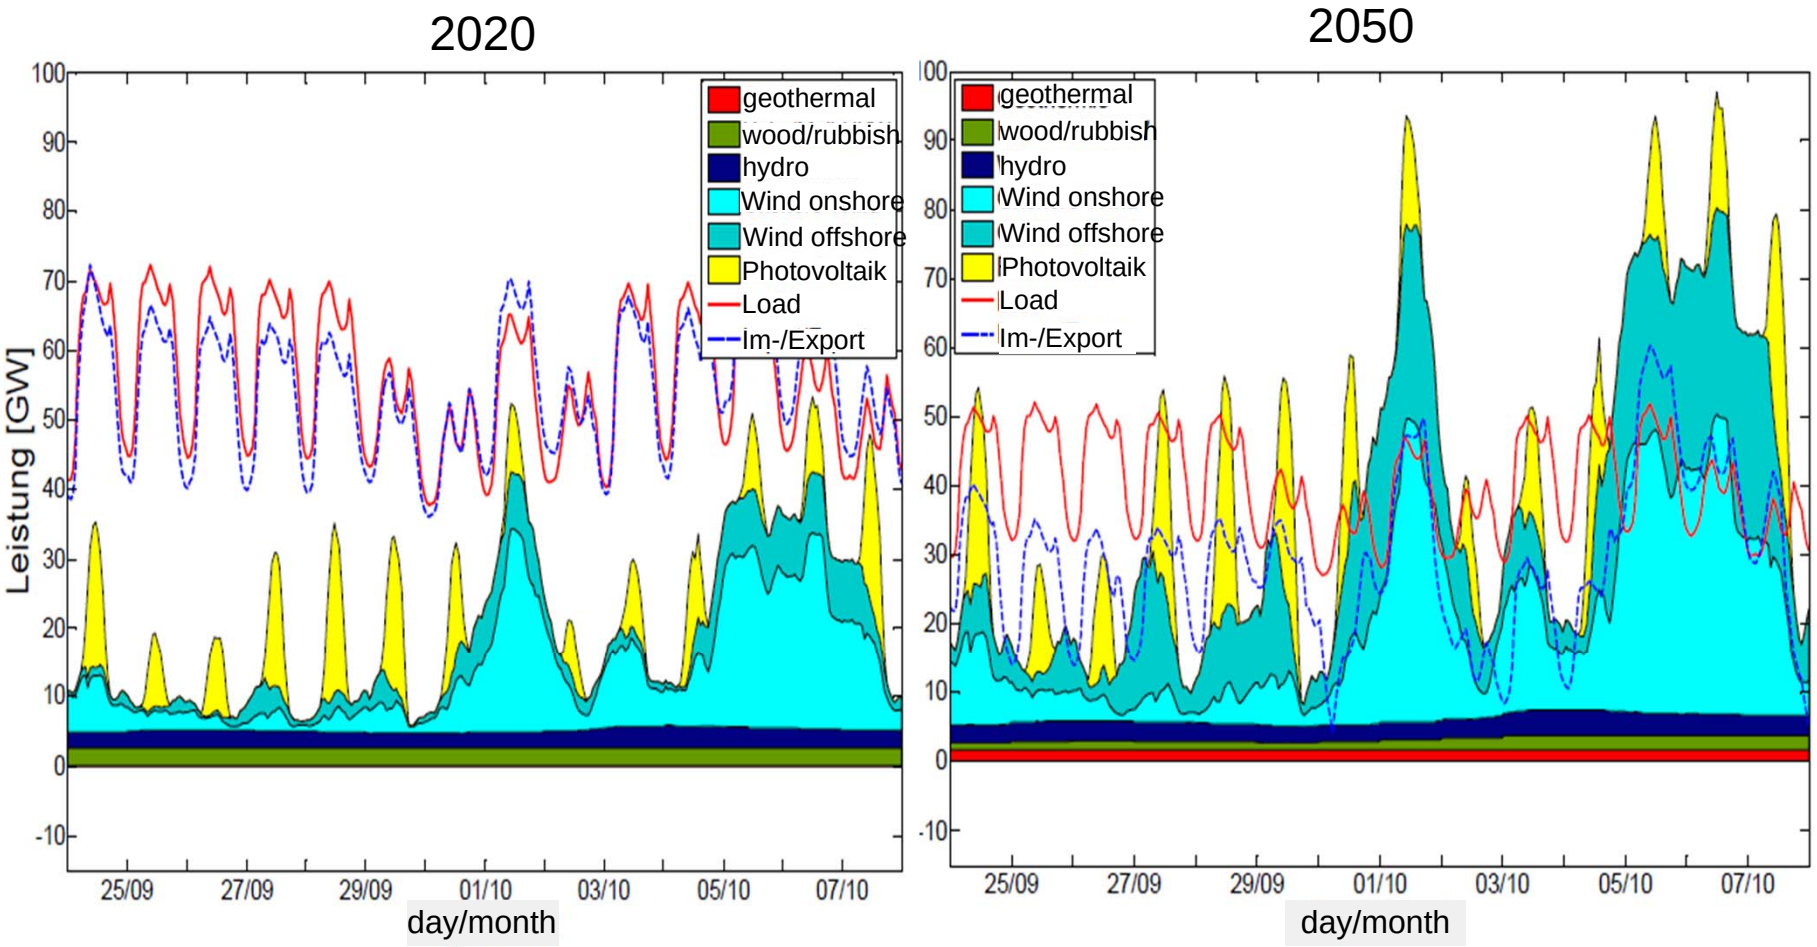

Source: Nitsch et. al 2012

Renewable heat production – the sleeping giant of climate protection

- Ambitious goals for renewable heating in Europe
- 10.4 % of German heat demand (heating; warm water) comes From RES (2012)
- In Germany around 90 % of a households energy demand is used for heating
- Only 3 renewable Sources

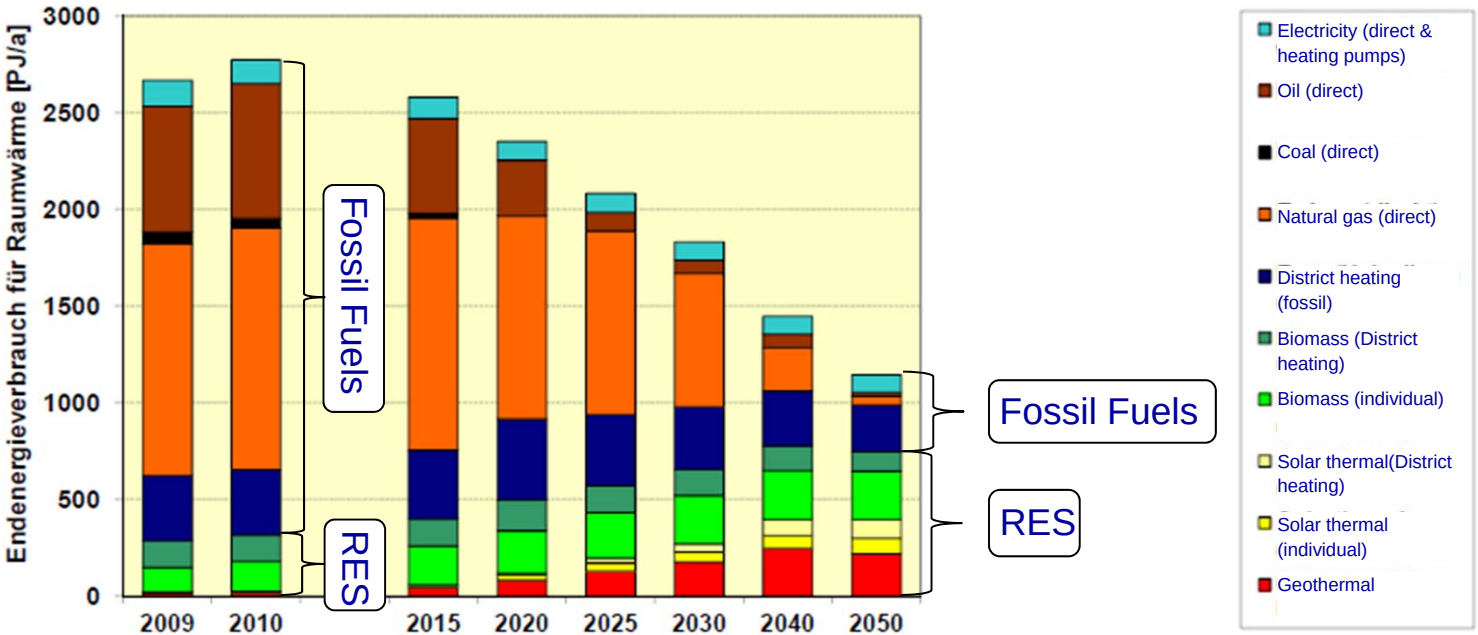

Source: Nitsch et. al 2012

Table of contents

1. Energy supply
   a. Regulation
   b. Energy trade
   c. Support Systems for RES in Europe
2. Electricity grid
   a. General structure of the electricity grid
   b. Power flows in Europe
   c. Integration of renewable energies
   d. Control of the European electricity grid
3. **Plant operation**
   a. Demand for geothermal power
   b. **Lessons learned**

Mineralisation of the brine (Bruchsal)

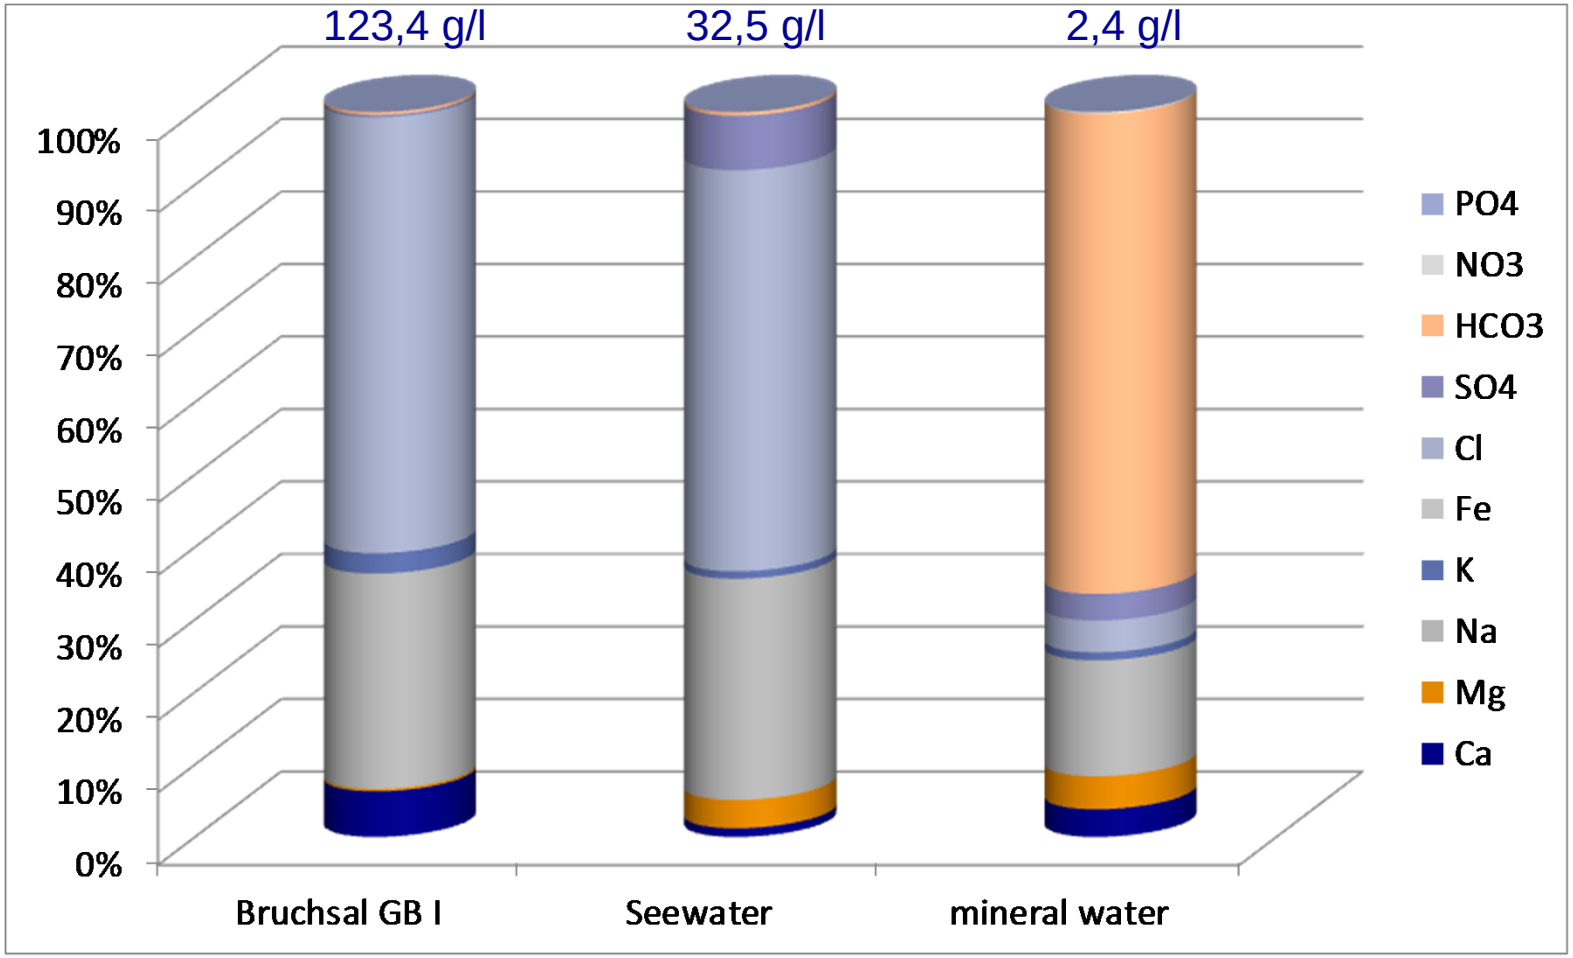

Scaling - Bruchsal

Source: ewb Bruchsal

Gas Composition - Bruchsal

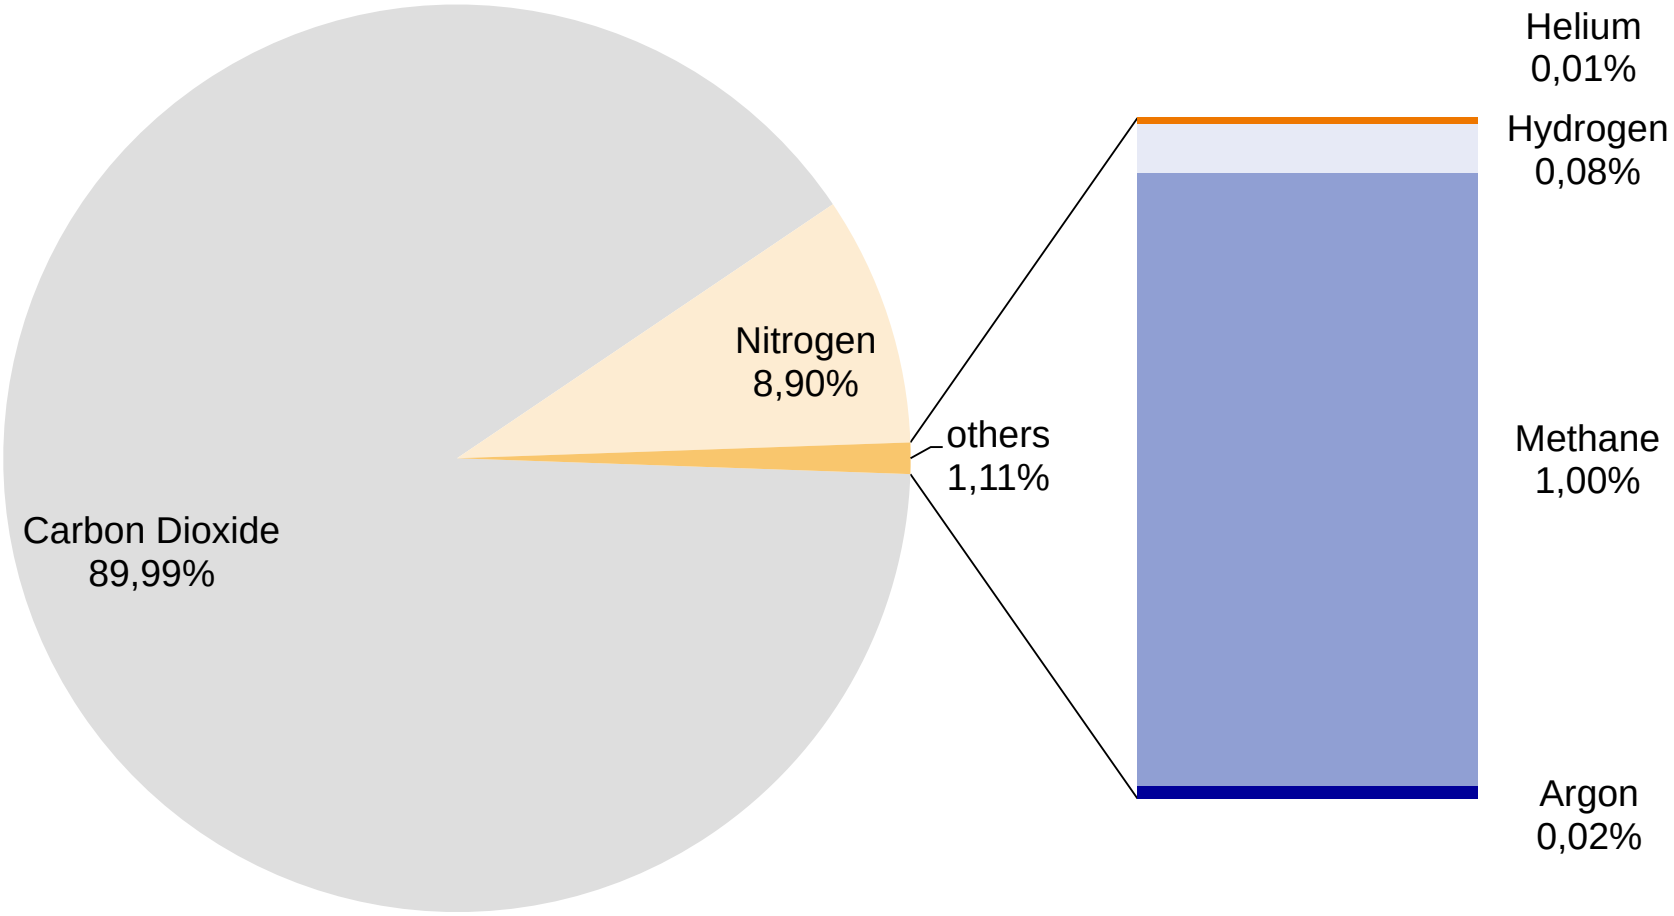

Two Phase Flow: CO_2 and Aqueous Phase

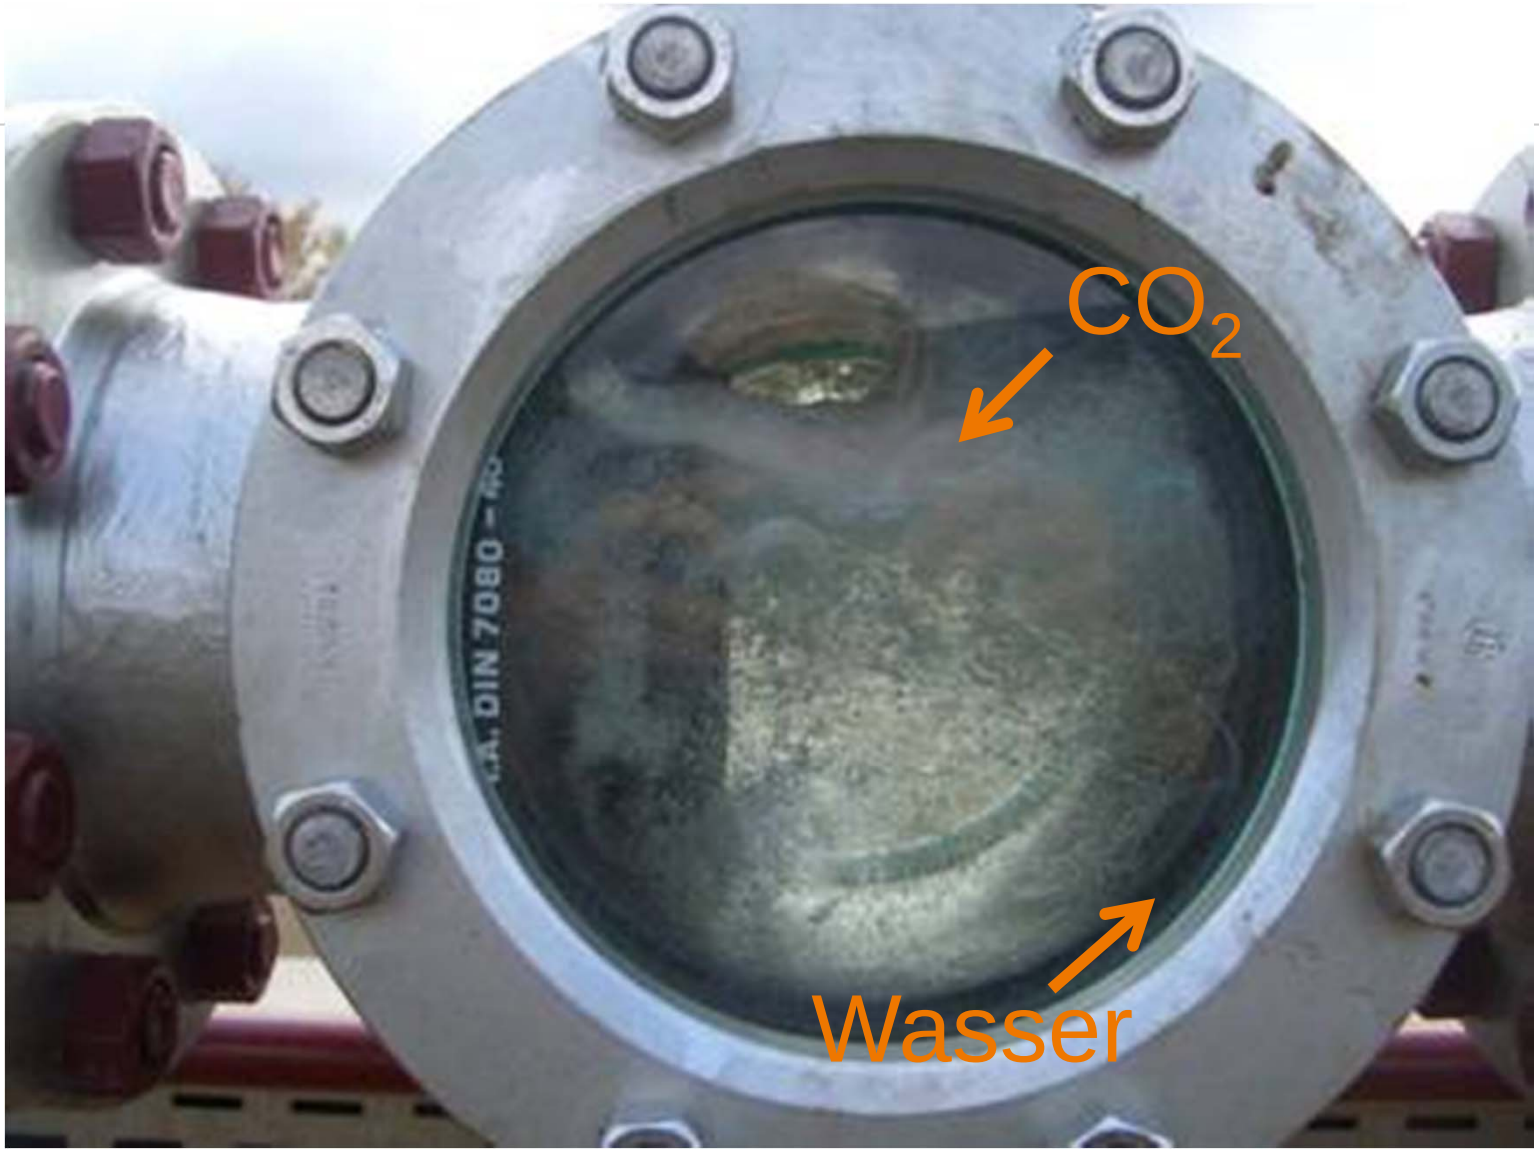

Two Phase Flow: CO_2 and Aqueous Phase

- Technical measures to prevent precipitations and low efficiency of heat exchange:
  - Pressure maintenance
  - Acidifying
  - Application of inhibitors

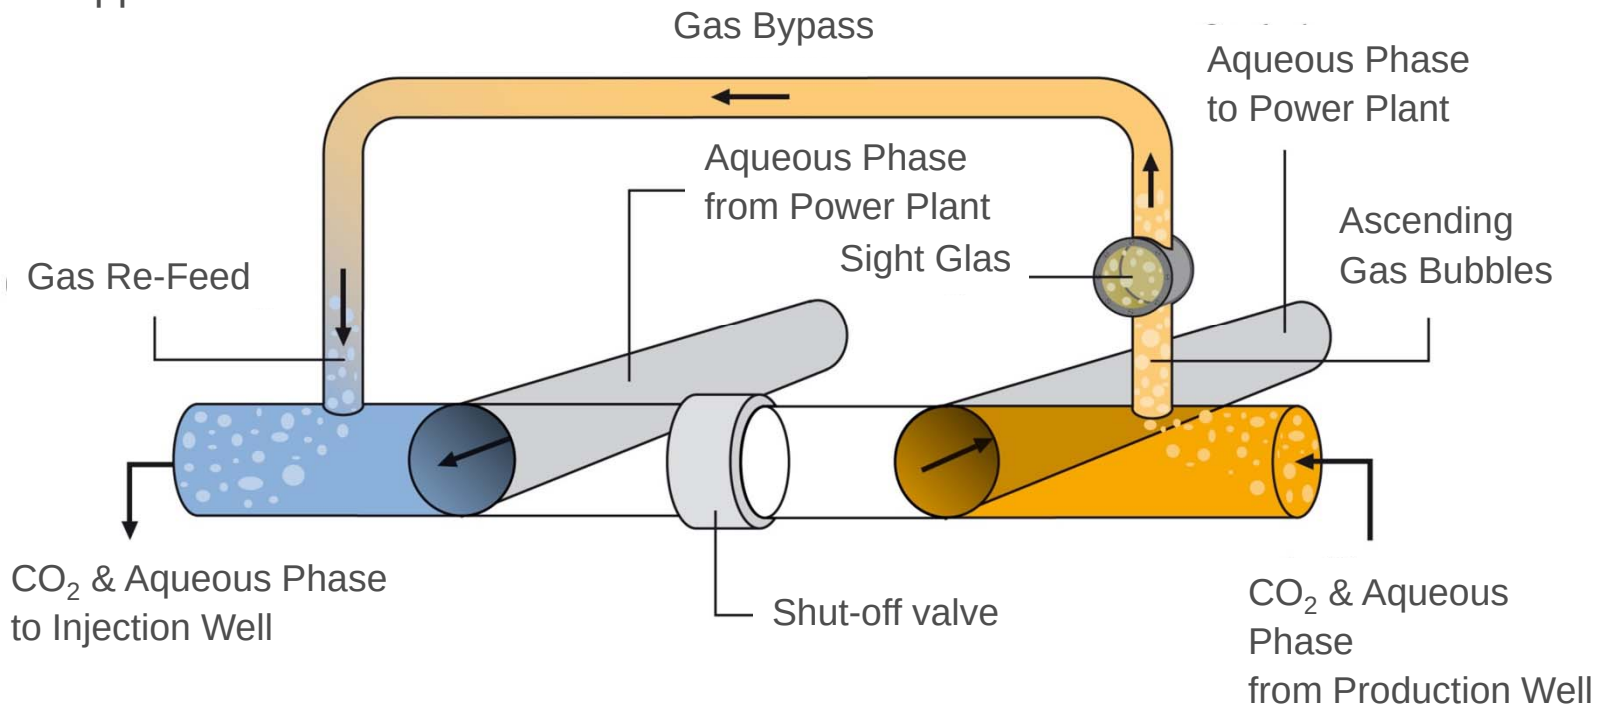

Pumping technologies applied and tested in Soultz

Three different kind of pumps are used in the geothermal loop

- Line Shaft Pump (LSP):
  - The hydraulic pump is down-hole, the motor drive is at surface, connection being done through a line shaft
    - ⇨ mechanical risk
- Electric Submersible Pump (ESP):
  - Both electrical motor and pump are down-hole, the motor drive is fed by a cable
    - ⇨ electrical risk
- Injection pumps :
  - horizontal, multistage high pressure pump (surface equipment)

Working principle and general configuration of LSP

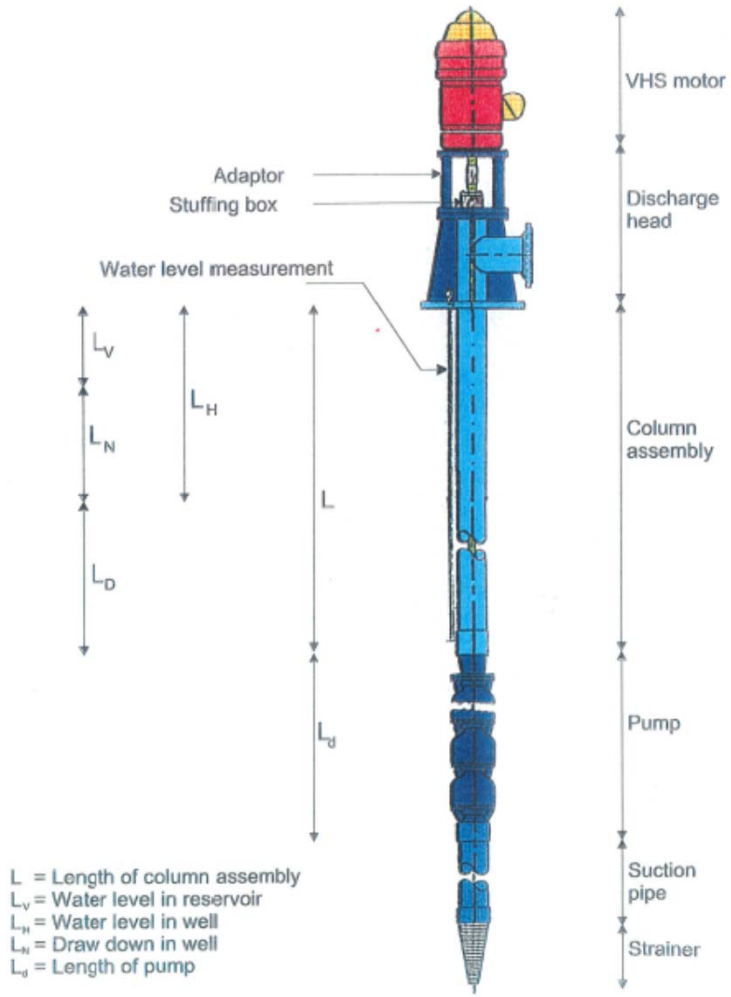

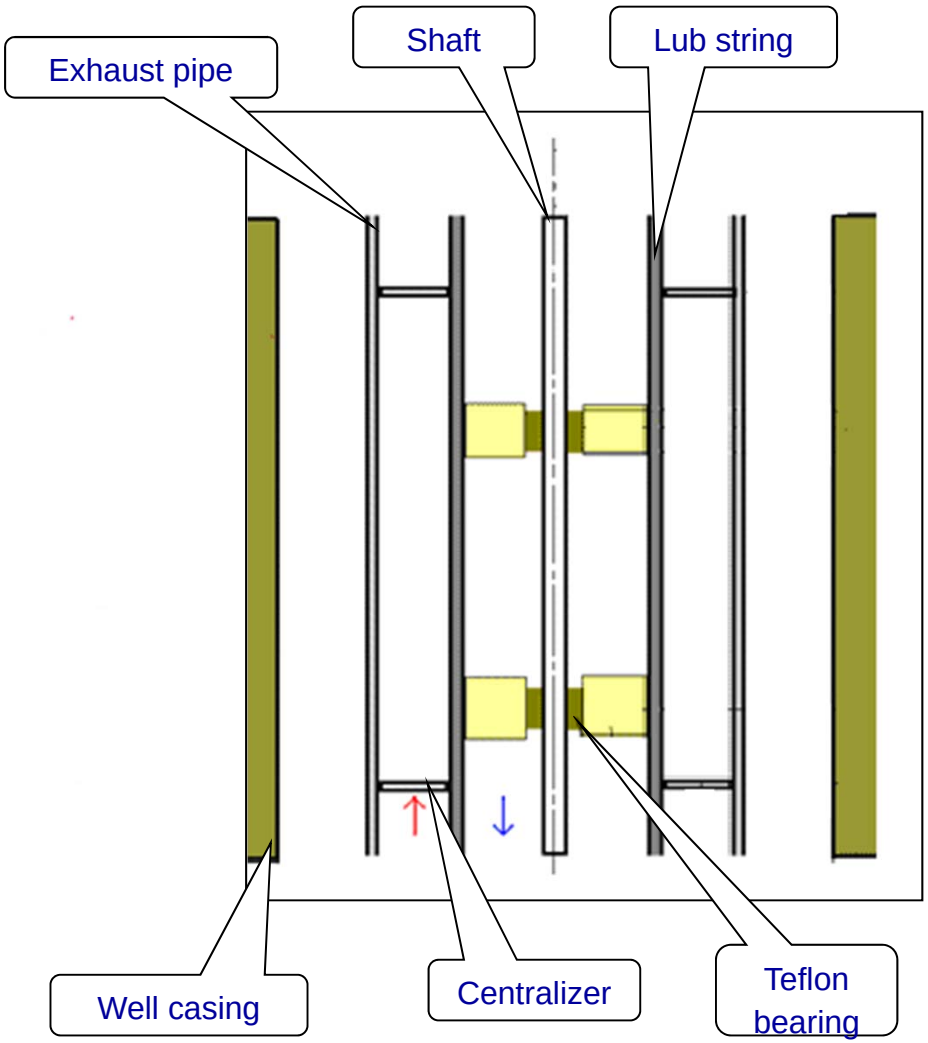

Ref: IGE Ldt.

Working principle and general configuration of LSP

riser, enclosing tube, shaft

Teflon bearings

hydraulic part, 17 stages

installation

motor/shaft coupling

view at well head/motor

Operating time and maintenance of LSP

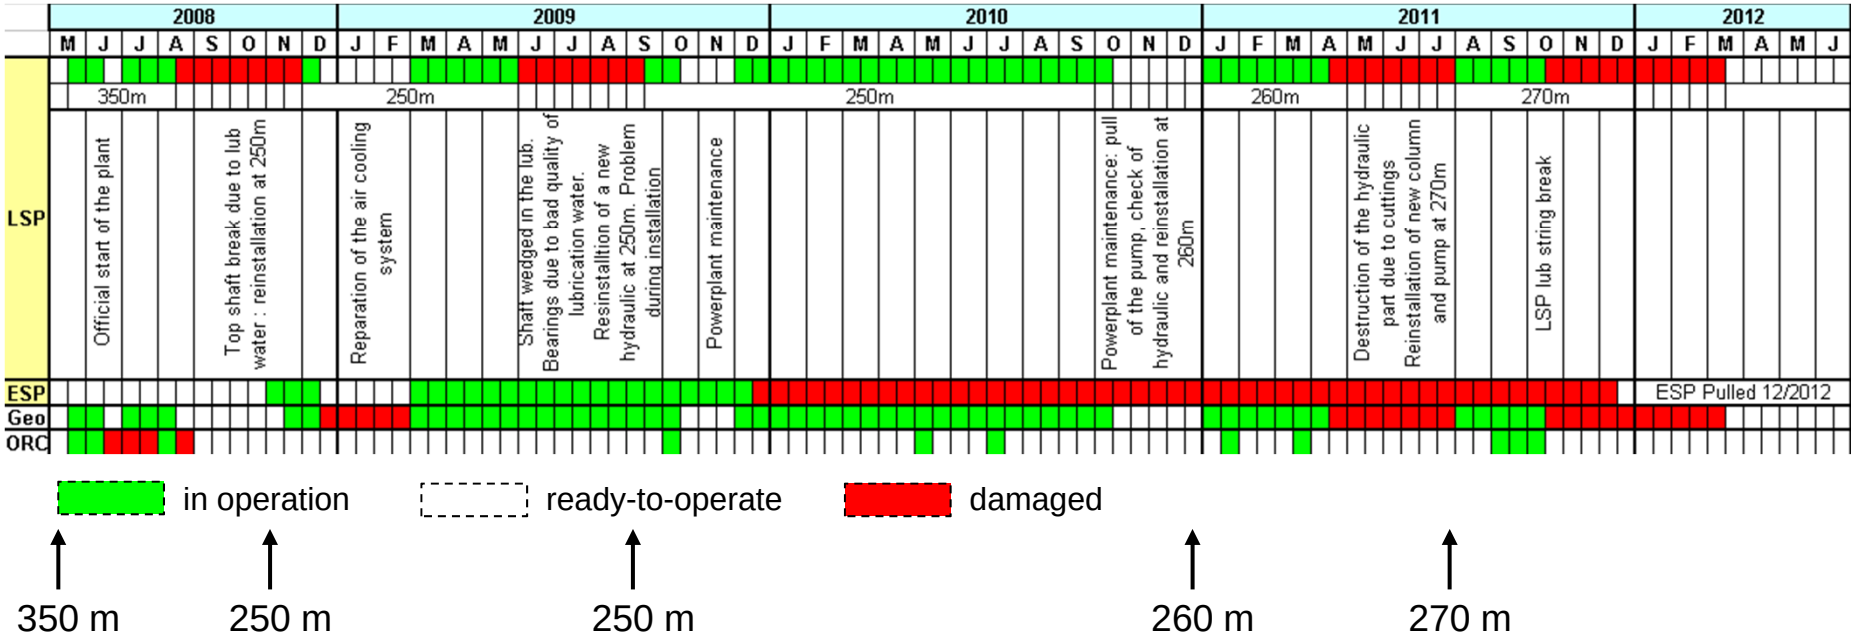

- The LSP pump has been installed/removed 5 times at different depth
- ~23 month of operation, ~15 to 20 start ups
- All installations have been carried out by the GEIE team.

Dismantling due to lubrication problems

- Failure mode
- Shaft wedged in enclosing tube and broke
- Caused by bad quality of lubricant (demineralized tap water)

- Problem solving
- Re-engineer of water treatment plant

Dismantling due to hydraulic problems

- Failure mode
- Damage of impellers (all stages), bearings, centralizers and enclosing tube
- Caused by abrasion, corrosion
- Problem solving
- Material selection, adapted operation conditions

Design and operation improvements done for the restart in March 2012

- Test of new bearing material (lub string): Bronze
- Increase the number of stages in order to decrease the rotation speed of the pump ⇨ avoid vibration problems
- Replacement of damaged parts (hydraulic part, piping)
- Adjustment of shaft diameter ⇨ reduce sleeve diameter from 47,5 to 47mm
- Renew surface connection (shaft/motor coupling)

Working principle and general configuration of ESP

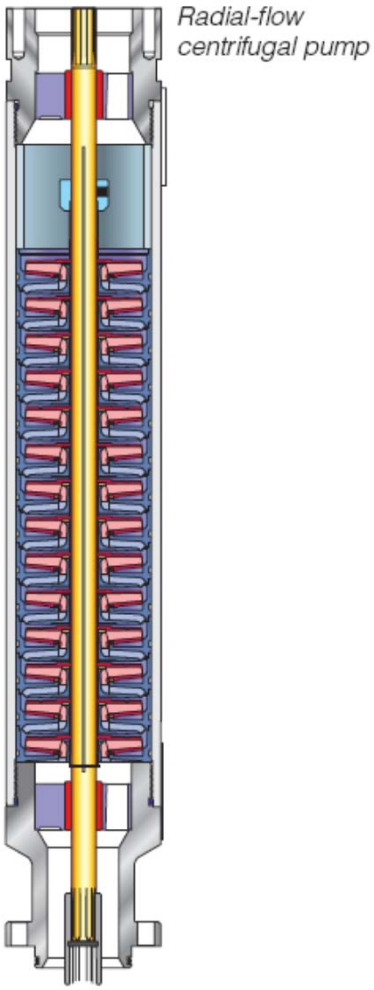

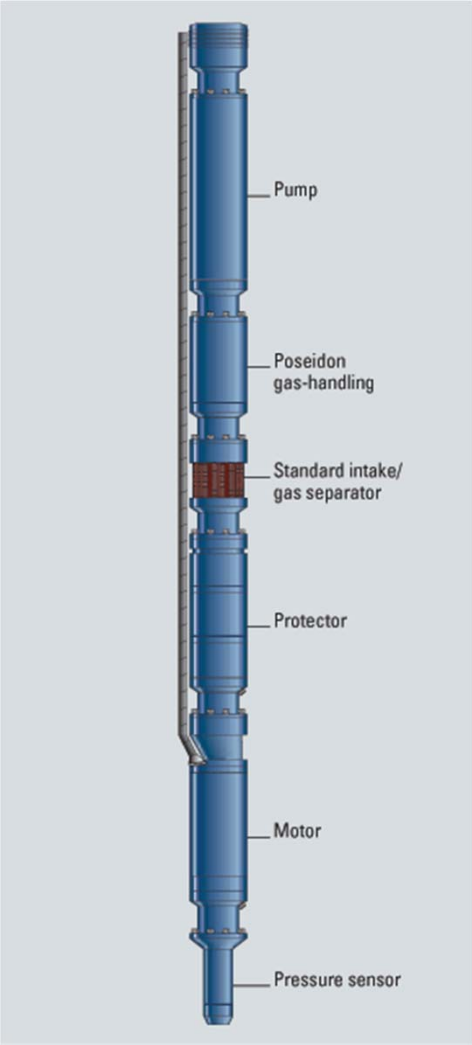

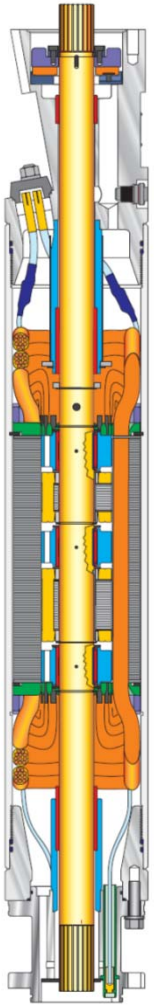

Ref: Reda/Schlumberger

Operating time of ESP

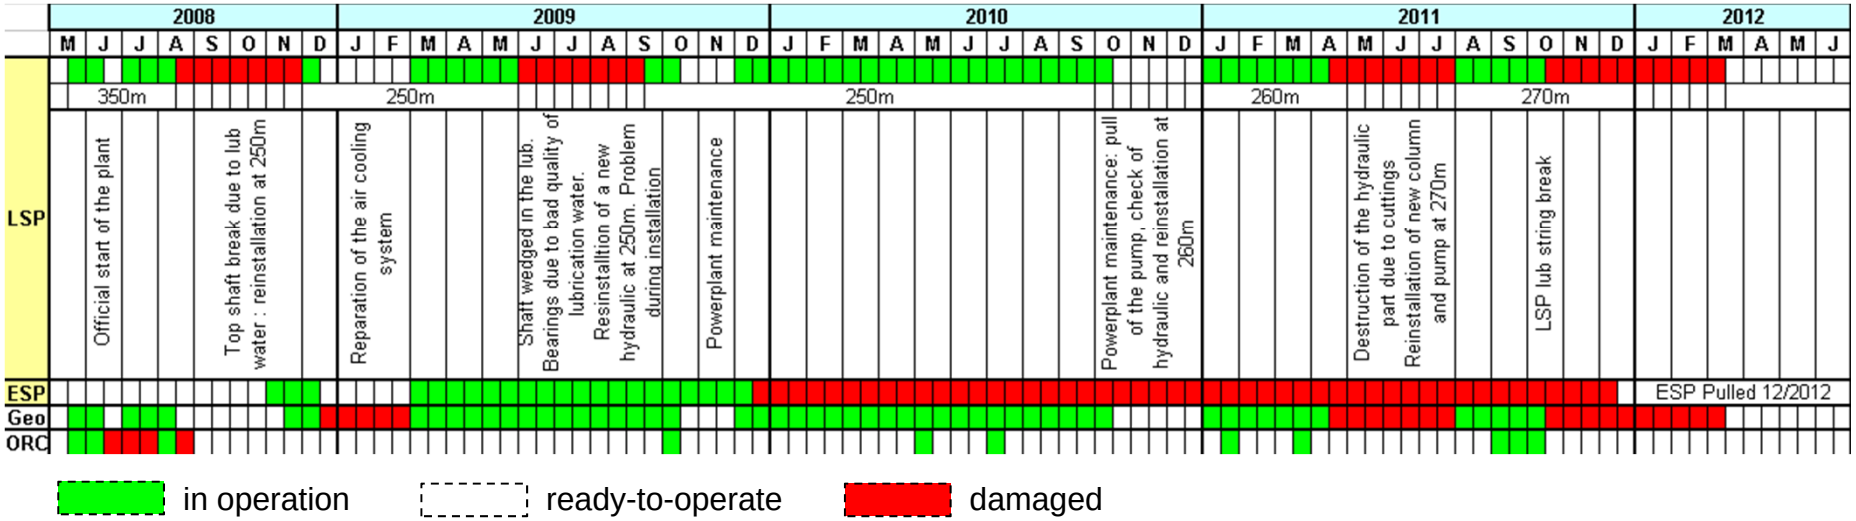

- The ESP was installed from November 2008 to December 2011
- 10 month of operation, 12 start ups
- Operation outside operating range, as GPK4 is no good producer

Injection pumps

- Injection pumps were used in 2008, 2009 and beginning of 2010 to re-inject the brine into GPK3
- Since 2010, trial of a new strategy without reinjection pump
- Today brine is re-injected in GPK3 (deep reservoir) and GPK1 (upper reservoir) without pumps
  - ⇨ System is working
  - ⇨ Temperature decrease of ~7 °C due to new concept

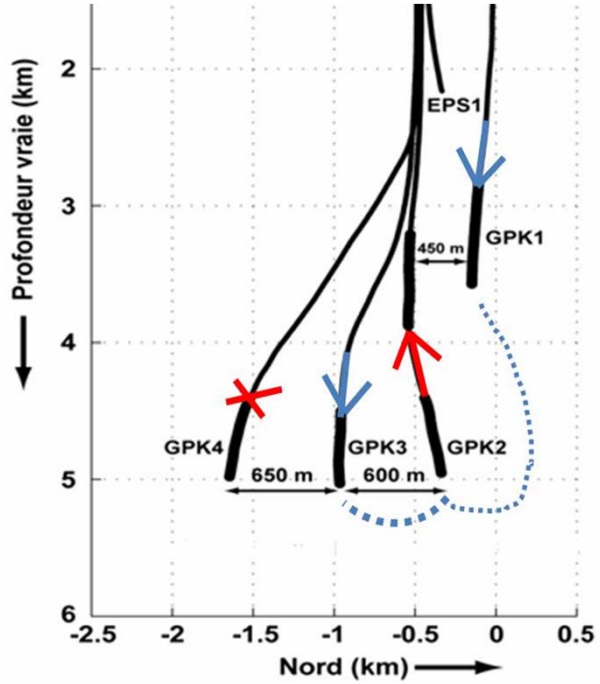

Comparison ORC and Kalina

ORC

Commercial available

Organic, pure fluid as working fluid

Isotherm evaporation and condensation

Higher exergetic loss

Less complex, no separators

Source G.E.I.E, 2010

Kalina

Currently only few power plants

Zeotropic mixture of Ammonia/water as working fluid

non.- isotherm evaporation and condensation

Better adaption of the cycle to the heat source

Separators necessary

Experience: operation is manageable

Engineering and design seems to be challeging

Outlook: Research in the field of deep geothermal energy

Environmental influences

- noise
- Natural radioactivity
- Optical influences
- etc.

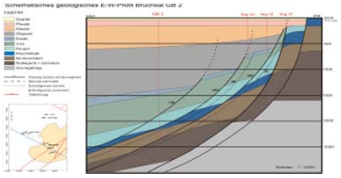

Quelle: AGW am KIT

Power plant technology

- corrosion
- scaling
- Aqueous chemistry
- Plant operation
- etc.

Reservoir

- Reservoir management
- seismicity
- Hydraulic behaviour of bore holes
- etc.

Thanks for your kind attention!